



TEST REPORT
IEC 60598-2-22
Luminaires
Part 2: Particular requirements
Section 22: Luminaires for emergency lighting

Report Number.....: LCS220105117BS

Date of issue.....: May 27, 2022

Total number of pages.....: 119 pages

**Name of Testing Laboratory
preparing the Report.....:** Shenzhen Southern LCS Compliance Testing Laboratory Ltd.

Applicant's name.....: Deshun Smart Technology Co., Ltd.

Address.....: No. 39, Dongqi Highway, Zhangjiagang City, Jiangsu, China

Test specification:

Standard.....: IEC 60598-2-22:2014+A1:2017 used in conjunction with
IEC 60598-1:2020

Test procedure.....: CE-LVD

Non-standard test method.....: N/A

TRF template used.....: IECEE OD-2020-F1:2021, Ed.1.4

Test Report Form No.....: IEC60598_2_22H

Test Report Form(s) Originator.....: Intertek Semko AB

Master TRF.....: Dated 2021-08-20

**Copyright © 2021 IEC System of Conformity Assessment Schemes for Electrotechnical
Equipment and Components (IECEE System). All rights reserved.**

This publication may be reproduced in whole or in part for non-commercial purposes as long as the IECEE is acknowledged as copyright owner and source of the material. IECEE takes no responsibility for and will not assume liability for damages resulting from the reader's interpretation of the reproduced material due to its placement and context.

If this Test Report Form is used by non-IECEE members, the IECEE/IEC logo and the reference to the CB Scheme procedure shall be removed.

This report is not valid as a CB Test Report unless signed by an approved IECEE Testing Laboratory and appended to a CB Test Certificate issued by an NCB in accordance with IECEE 02.

General disclaimer:

The test results presented in this report relate only to the object tested.

This report shall not be reproduced, except in full, without the written approval of the Issuing Testing Laboratory. The authenticity of this Test Report and its contents can be verified by contacting the Testing Laboratory, responsible for this Test Report.



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.

Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China

Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com

Scan code to check authenticity



Test item description.....:	LED exit emergency light	
Trade Mark.....:	--	
Manufacturer.....:	As the same applicant	
Address.....:	As the same applicant address	
Model/Type reference.....:	See model list on page 5	
Ratings.....:	See model list on page 5	
<input checked="" type="checkbox"/> Testing Laboratory:		
Testing location/ address.....:	Shenzhen Southern LCS Compliance Testing Laboratory Ltd. 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China	
Tested by.....:	Yeoh Zhang (Engineer)	<i>Yeoh Zhang</i>
Check by.....:	Torres He (Director)	<i>Torres He</i>
Approved by.....:	Jesse Liu (Manager)	<i>Jesse Liu</i>
List of Attachments (including a total number of pages in each attachment): Attachment No. 1: European group differences and national differences according to EN 60598-2-22:2014+A1:2020 used in conjunction with EN IEC 60598-1:2021 Attachment No. 2: Report IEC 62031. Attachment No. 3: Report IEC TR 62778. Attachment No. 4: Report IEC 61347-2-7. Attachment No. 5: Report IEC 61347-2-13. Attachment No. 6: Photo documentation.		
Summary of testing:		
Tests performed (name of test and test clause): IEC 60598-2-22:2014+A1:2017 IEC 60598-1:2020 IEC TR 62778:2014 IEC 62031:2018 IEC 62493:2015 IEC 61347-2-7:2011+A1:2017 IEC 61347-2-13: 2014+A1: 2016 IEC 61347-1:2015+A1:2017	Testing location: Shenzhen Southern LCS Compliance Testing Laboratory Ltd. 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China	
Summary of compliance with National Differences:		
List of countries addressed <input checked="" type="checkbox"/> The product fulfils the requirements of Germany and European Group differences EN 60598-2-22:2014+A1:2020; EN IEC 60598-1:2021; EN 62493:2015; EN IEC 62031:2020;		





EN 61347-2-7:2012+A1:2019; EN 61347-2-13:2014+A1:2017; EN 61347-1:2015+A1:2021





Copy of marking plate:

The artwork below may be only a draft. The use of certification marks on a product must be authorized by the respective NCBs that own these marks.

Label of luminaires:**For automatic test function model:**

LED emergency light			
X	0	F	180

Model No.: DS-ES-04S
220-240V, 50/60Hz, Emergency power:1.5W,





    ta.40°C, C0:D0.32 C90:D8

Replaceable battery: IFR 18650-1.6Ah 6.4V 1600mAh
Deshun Smart Technology Co., Ltd.
No. 39, Dongqi Highway, Zhangjiagang
City, Jiangsu, China
Importer No.:xxxxxxxxxx

For manual test function:

LED emergency light			
X	1	A	180

Model No.: DS-ES-04M
220-240V, 50/60Hz, Emergency power:1.5W,

    ta.40°C, C0:D0.32 C90:D8

Replaceable battery: IFR 18650-1.6Ah 6.4V 1600mAh
Deshun Smart Technology Co., Ltd.
No. 39, Dongqi Highway, Zhangjiagang
City, Jiangsu, China
Importer No.:xxxxxxxxxx

WARNING:

ALL MAINTENANCE, SUCH AS BATTERY CHANGE ON THIS LUMINAIRE, TO BE PERFORMED BY QUALIFIED PERSONNEL ONLY.
DE-ENERGISE ALL SUPPLIES BEFORE MAINTENANCE.

Label of battery:


Li-ion Battery: IFR 18650-1.6Ah
6.4V 1600mAh

Temperature Classification: 0°C~55°C

Charge regime: Constant current

Manufacture Date: YY-MM-DD

Battery rated to operate for 3 hours, replace battery if tested duration is less than 3 hours.

**Remarks:**

Height of WEEE symbol should not less than 7mm, height of other marks at least 5mm, height of letters and numerals at least 2mm.



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.

Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China

Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com

Scan code to check authenticity



Test item particulars :									
Classification of installation and use.....:	Luminaires for emergency lighting								
Supply Connection.....:	Terminal block								
Protection Class.....:	Class II								
Degree of Protection.....:	IP20								
Possible test case verdicts:									
- test case does not apply to the test object.....:	N/A								
- test object does meet the requirement.....:	P (Pass)								
- test object does not meet the requirement.....:	F (Fail)								
Testing.....:									
Date of receipt of test item.....:	2022-04-06								
Date (s) of performance of tests.....:	2022-04-06 ~ 2022-05-25								
General remarks:									
<p>"(See Enclosure #)" refers to additional information appended to the report. "(See appended table)" refers to a table appended to the report. Clause numbers with "*" were not within the scope of CNAS recognition. Clause numbers between brackets refer to clauses in IEC/EN IEC 60598-1. The general information of applicant and manufacturer (such as the name and address), product name, model/type reference, trademark and other similar information contained in this report are all provided by the applicant, the laboratory is not responsible for verifying its authenticity.</p> <p>Throughout this report a <input type="checkbox"/> comma / <input checked="" type="checkbox"/> point is used as the decimal separator.</p> <p>According to the EU directives which have been aligned with EU NLF (new legislative framework), both of manufacturer and importer's name and address shall be affixed on the product or, where that is not possible, on its packaging or in a document accompanying the product before the product is placed on the EU market.</p> <p style="text-align: center;">Modified Information</p> <table border="1" style="width: 100%;"><thead><tr><th>Version</th><th>Report No.</th><th>Revision Date</th><th>Summary</th></tr></thead><tbody><tr><td>V1.0</td><td>LCS220105117BS</td><td>/</td><td>Original Version</td></tr></tbody></table>		Version	Report No.	Revision Date	Summary	V1.0	LCS220105117BS	/	Original Version
Version	Report No.	Revision Date	Summary						
V1.0	LCS220105117BS	/	Original Version						
Manufacturer's Declaration per sub-clause 4.2.5 of IEC 60598-1:									
The application for obtaining a CB Test Certificate includes more than one factory location and a declaration from the Manufacturer stating that the sample(s) submitted for evaluation is (are) representative of the products from each factory has been provided.....:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> Not applicable								
When differences exist; they shall be identified in the General product information section.									
Name and address of factory (ies).....: Same as manufacturer									



**General product information:**

1. All models are equipped with the same integral SELV emergency control gear and battery, except the appearance. The suffix with "M" represents manual test function, with "S" represent automatic test function. The manual test function is maintained, the automatic test function is the non-maintained.
2. Unless otherwise specified, the model DS-ES-04M was chosen as representative model to perform all test. DS-ES-01M and DS-ES-03M were test in difference tests.

Model list:

Model No.	Rating	Battery
DS-ES-01M	220-240V~, 50/60Hz, ta.40℃, Emergency power:1.5W, IP20	IFR 18650-1.6Ah 6.4V 1600mAh
DS-ES-02M	220-240V~, 50/60Hz, ta.40℃, Emergency power:1.5W, IP20	IFR 18650-1.6Ah 6.4V 1600mAh
DS-ES-03M	220-240V~, 50/60Hz, ta.40℃, Emergency power:1.5W, IP20	IFR 18650-1.6Ah 6.4V 1600mAh
DS-ES-04M	220-240V~, 50/60Hz, ta.40℃, Emergency power:1.5W, IP20	IFR 18650-1.6Ah 6.4V 1600mAh
DS-ES-05M	220-240V~, 50/60Hz, ta.40℃, Emergency power:1.5W, IP20	IFR 18650-1.6Ah 6.4V 1600mAh
DS-ES-06M	220-240V~, 50/60Hz, ta.40℃, Emergency power:1.5W, IP20	IFR 18650-1.6Ah 6.4V 1600mAh
DS-ES-01S	220-240V~, 50/60Hz, ta.40℃, Emergency power:1.5W, IP20	IFR 18650-1.6Ah 6.4V 1600mAh
DS-ES-02S	220-240V~, 50/60Hz, ta.40℃, Emergency power:1.5W, IP20	IFR 18650-1.6Ah 6.4V 1600mAh
DS-ES-03S	220-240V~, 50/60Hz, ta.40℃, Emergency power:1.5W, IP20	IFR 18650-1.6Ah 6.4V 1600mAh
DS-ES-04S	220-240V~, 50/60Hz, ta.40℃, Emergency power:1.5W, IP20	IFR 18650-1.6Ah 6.4V 1600mAh
DS-ES-05S	220-240V~, 50/60Hz, ta.40℃, Emergency power:1.5W, IP20	IFR 18650-1.6Ah 6.4V 1600mAh
DS-ES-06S	220-240V~, 50/60Hz, ta.40℃, Emergency power:1.5W, IP20	IFR 18650-1.6Ah 6.4V 1600mAh



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.

Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China

Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com

Scan code to check authenticity



IEC 60598-2-22			
Clause	Requirement + Test	Result - Remark	Verdict
22.4 (0)	GENERAL TEST REQUIREMENTS		P
22.4 (0.3)	More sections applicable.....:	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> Section/s:	—
22.4 (0.5)	Components	(see Annex 1)	—
22.4 (0.7)	Information for luminaire design in light sources standards		—
22.4 (0.7.2)	Light source safety standard	IEC 62031 IEC TR 62778	—
	Luminaire design in the light source safety standard		—
22.4 (-)	Part provide normal lighting, test according relevant part of IEC 60598-2		N/A
22.4 (-)	Adjacent part fulfils relevant part of this part 2		P
22.4 (-)	Self-contained portable emergency luminaires, requirements according Annex E	(see Annex E)	N/A
22.5 (2)	CLASSIFICATION OF LUMINAIRES		P
22.5 (2.2)	Type of protection	Class II	P
22.5 (2.3)	Degree of protection.....:	IP20	—
22.5 (2.4)	Luminaire suitable for direct mounting on normally flammable surfaces.....:	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>	—
22.5 (2.5)	Luminaire for normal use	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>	—
	Luminaire for rough service	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	—
22.5 (-)	Classified as luminaire suitable for direct mounting on normally flammable surfaces		P
22.5 (-)	Classification code according Annex B	(see Annex B)	P
22.6 (3)	MARKING		P
22.6 (3.2)	Mandatory markings		P
	Position of the marking		P
	Format of symbols/text		P
22.6 (3.3)	Additional information		P
	Language of instructions	English	P
22.6 (3.3.1)	Combination luminaires		N/A
22.6 (3.3.2)	Nominal frequency in Hz	50/60Hz	P
22.6 (3.3.3)	Operating temperature		N/A



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.

Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China

Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com

Scan code to check authenticity



IEC 60598-2-22			
Clause	Requirement + Test	Result - Remark	Verdict
22.6 (3.3.4)	Symbol or warning notice		N/A
22.6 (3.3.5)	Wiring diagram	See user manual	P
22.6 (3.3.6)	Special conditions		N/A
22.6 (3.3.7)	Metal halide lamp luminaire – warning		N/A
22.6 (3.3.8)	Limitation for semi-luminaires		N/A
22.6 (3.3.9)	Power factor and supply current		N/A
22.6 (3.3.10)	Suitability for use indoors		N/A
22.6 (3.3.11)	Luminaires with remote control		N/A
22.6 (3.3.12)	Clip-mounted luminaire – warning		N/A
22.6 (3.3.13)	Specifications of protective shields		N/A
22.6 (3.3.14)	Symbol for nature of supply	~	P
22.6 (3.3.15)	Rated current of socket outlet		N/A
22.6 (3.3.16)	Rough service luminaire		N/A
22.6 (3.3.17)	Mounting instruction for type Y, type Z and some type X attachments		N/A
22.6 (3.3.18)	Non-ordinary luminaires with PVC cable		N/A
22.6 (3.3.19)	Protective conductor current in instruction if applicable		N/A
22.6 (3.3.20)	Provided with information if not intended to be mounted within arm's reach		N/A
22.6 (3.3.21)	Non replaceable and non-user replaceable light sources information provided	Non-user replaceable	P
	Cautionary symbol		N/A
22.6 (3.3.22)	Controllable luminaires, classification of insulation provided		N/A
22.6 (3.4)	Test with water	15s	P
	Test with hexane	15s	P
	Legible after test	Label is legible	P





IEC 60598-2-22			
Clause	Requirement + Test	Result - Remark	Verdict
	Label attached	Label no curling	P
22.6.1 (-)	Supply voltage	220-240VAC	P
22.6.2 (-)	Classification according to annex B		P
22.6.3 (-)	Correct replacement lamp	Non-user replaceable LEDs	N/A
22.6.4 (-)	Range of ambient temperatures	ta: 40°C	P
22.6.5 (-)	Fuse ratings and/or indicator lamps	Non-replaceable fuse and Non-replaceable indicator lamps	N/A
22.6.6 (-)	Facilities to simulate normal supply failure		P
22.6.7 (-)	Marked with correct battery replacement	See user manual	P
	Non-replaceable batteries		N/A
22.6.8 (-)	Battery marked with date of manufacture		P
	Space provided on battery label		P
22.6.9 (-)	Correct lamp replacement for combined emergency luminaires		N/A
	Green dot with min 5 mm diameter		N/A
	Instruction leaflet 22.6.10 – 22.6.12 and 22.6.14 – 22.6.16		N/A
22.6.10 (-)	Replacement of battery or luminaire	See user manual	P
22.6.11 (-)	Details of test facilities	For the manual test function	P
22.6.12 (-)	Details of connection leads		N/A
22.6.14 (-)	Details of device which changes the mode of operation		P
22.6.15 (-)	Photometric data available according 22.17		P
22.6.16 (-)	Any normal preparation procedure		P
22.6.17 (-)	Marking in 22.6.1, 22.6.2, 22.6.7 and 22.6.20 visible on installed luminaire		P
	Marking in 22.6.5, 22.6.7 and 22.6.9 visible during maintenance		P
22.6.18 (-)	Provided with warning if intended for external plug and socket connections		N/A
22.6.19 (-)	Instruction leaflet specifies if lamp and/or battery is/are non-replaceable		N/A
22.6.20 (-)	Marking if luminaire mounted on lighting track systems		N/A
	Photometric data in instruction leaflet		N/A





IEC 60598-2-22			
Clause	Requirement + Test	Result - Remark	Verdict
22.7(4)	CONSTRUCTION		P
22.7 (4.2)	Components replaceable without difficulty		P
22.7 (4.3)	Wireways smooth and free from sharp edges		P
22.7 (4.4)	Lampholders		N/A
22.7 (4.4.1)	Integral lampholder		N/A
22.7 (4.4.2)	Wiring connection		N/A
22.7 (4.4.3)	Lampholder for end-to-end mounting		N/A
22.7 (4.4.4)	Positioning		N/A
	- pressure test (N)	--	—
	After test the lampholder comply with relevant standard sheets and show no damage		N/A
	After test on single-capped lampholder the lampholder have not moved from its position and show no permanent deformation		N/A
	- bending test (N)	--	—
	After test the lampholder have not moved from its position and show no permanent deformation		N/A
22.7 (4.4.5)	Peak pulse voltage		N/A
22.7 (4.4.6)	Centre contact		N/A
22.7 (4.4.7)	Parts in rough service luminaires resistant to tracking		N/A
22.7 (4.4.8)	Lamp connectors		N/A
22.7 (4.4.9)	Caps and bases correctly used		N/A
22.7 (4.4.10)	Light source for lampholder or connection according IEC 60061 not connected another way		N/A
22.7 (4.5)	Starter holders		N/A
	Starter holder in luminaires other than class II		N/A
	Starter holder class II construction		N/A
22.7 (4.6)	Terminal blocks		N/A
	Tails		N/A
	Unsecured blocks		N/A
22.7 (4.7)	Terminals and supply connections		P
22.7 (4.7.1)	Contact to metal parts		P
22.7 (4.7.2)	Test 8 mm live conductor		P
	Test 8 mm earth conductor		N/A





IEC 60598-2-22			
Clause	Requirement + Test	Result - Remark	Verdict
22.7 (4.7.3)	Terminals for supply conductors		P
22.7 (4.7.3.1)	Welded method and material		N/A
	- stranded or solid conductor		N/A
	- spot welding		N/A
	- welding between wires		N/A
	- Type Z attachment		N/A
	- mechanical test according to 15.6.2		N/A
	- electrical test according to 15.6.3		N/A
	- heat test according to 15.6.3.2.3 and 15.6.3.2.4		N/A
22.7 (4.7.4)	Terminals other than supply connection		N/A
22.7 (4.7.5)	Heat-resistant wiring/sleeves		N/A
22.7 (4.7.6)	Multi-pole plug		N/A
	- test at 30 N		N/A
22.7 (4.8)	Switches		P
	- adequate rating		P
	- adequate fixing		P
	- polarized supply		N/A
	- compliance with IEC 61058-1 for electronic switches	Confirmed for 10,000 operating cycles (for test switch)	P
22.7 (4.9)	Insulating lining and sleeves		N/A
22.7 (4.9.1)	Retainment		N/A
	Method of fixing.....:	--	N/A
22.7 (4.9.2)	Insulated linings and sleeves:		N/A
	Resistant to a temperature > 20 °C to the wire temperature or		N/A
	a) & c) Insulation resistance and electric strength		N/A
	b) Ageing test. Temperature (°C).....:	--	N/A
22.7 (4.10)	Double or reinforced insulation		N/A
22.7 (4.10.1)	No contact, mounting surface – accessible metal parts – wiring of basic insulation		N/A
	Safe installation fixed luminaires		N/A
	Capacitors and switches		N/A





IEC 60598-2-22			
Clause	Requirement + Test	Result - Remark	Verdict
	Interference suppression capacitors according to IEC 60384-14		N/A
22.7 (4.10.2)	Assembly gaps:		N/A
	- not coincidental		N/A
	- no straight access with test probe		N/A
22.7 (4.10.3)	Retention of insulation:		N/A
	- fixed		N/A
	- unable to be replaced; luminaire inoperative		N/A
	- sleeves retained in position		N/A
	- lining in lampholder		N/A
22.7 (4.10.4)	Protective impedance device		N/A
	Double or reinforced insulation bridged by appropriate and at least two resistors or two Y2 capacitors or one Y1 capacitor		N/A
	Y1 or Y2 capacitors comply with IEC 60384-14		N/A
	Resistors comply with test (a) in 14.1 of IEC 60065		N/A
22.7 (4.11)	Electrical connections and current-carrying parts		P
22.7 (4.11.1)	Contact pressure		N/A
22.7 (4.11.2)	Screws:		N/A
	- self-tapping screws		N/A
	- thread-cutting screws		N/A
22.7 (4.11.3)	Screw locking:		N/A
	- spring washer		N/A
	- rivets		N/A
22.7 (4.11.4)	Material of current-carrying parts		P
22.7 (4.11.5)	No contact to wood or mounting surface		P





IEC 60598-2-22			
Clause	Requirement + Test	Result - Remark	Verdict
22.7 (4.11.6)	Electro-mechanical contact systems		N/A
22.7 (4.12)	Screws and connections (mechanical) and glands		P
22.7 (4.12.1)	Screws not made of soft metal		P
	Screws of insulating material		N/A
	Torque test: torque (Nm); part..... :	Fixed enclosure: 1.2Nm	P
	Torque test: torque (Nm); part..... :	Fixed driver: 0.6Nm	P
	Torque test: torque (Nm); part..... :		S
22.7 (4.12.2)	Screws with diameter < 3 mm screwed into metal		N/A
22.7 (4.12.4)	Locked connections:		N/A
	- fixed arms; torque (Nm)..... :	--	N/A
	- lampholder; torque (Nm)..... :	--	N/A
	- push-button switches; torque 0,8 Nm..... :	--	N/A
22.7 (4.12.5)	Screwed glands; force (Nm)..... :	--	N/A
22.7 (4.13)	Mechanical strength		P
22.7 (4.13.1)	Impact tests:		P
	- fragile parts; energy (Nm)..... :	--	N/A
	- other parts; energy (Nm)..... :	For all parts: 0.35Nm	P
	1) live parts		P
	2) linings		N/A
	3) protection		P
	4) covers		P
22.7 (4.13.3)	Straight test finger		P
22.7 (4.13.4)	Rough service luminaires		N/A
	- IP54 or higher		N/A
	a) fixed		N/A
	b) hand-held		N/A
	c) delivered with a stand		N/A





IEC 60598-2-22			
Clause	Requirement + Test	Result - Remark	Verdict
	d) for temporary installations and suitable for mounting on a stand		N/A
22.7 (4.13.6)	Tumbling barrel		N/A
22.7 (4.14)	Suspensions, fixings and means of adjusting		P
22.7 (4.14.1)	Mechanical load:		P
	A) four times the weight		P
	B) torque 2,5 Nm		N/A
	C) bracket arm; bending moment (Nm)..... :	--	N/A
	D) load track- mounted luminaires		N/A
	E) clip-mounted luminaires, glass-shelve. Thickness (mm)	--	N/A
	Metal rod. diameter (mm)	--	N/A
	Fixed luminaire or independent control gear without fixing devices		N/A
22.7 (4.14.2)	Load to flexible cables		N/A
	Mass (kg)	--	N/A
	Stress in conductors (N/mm ²)	--	N/A
	Mass (kg) of semi-luminaire	--	N/A
	Bending moment (Nm) of semi-luminaire	--	N/A
22.7 (4.14.3)	Adjusting devices:		N/A
	- flexing test; number of cycles..... :	--	N/A
	- strands broken..... :	--	N/A
	- electric strength test afterwards		N/A
22.7 (4.14.4)	Telescopic tubes: cords not fixed to tube; no strain on conductors		N/A
22.7 (4.14.5)	Guide pulleys		N/A
22.7 (4.14.6)	Strain on socket-outlets		N/A
22.7 (4.15)	Flammable materials		N/A
	- glow- wire test 650°C..... :	See Test Table 22.16 (13.3.2)	N/A





IEC 60598-2-22			
Clause	Requirement + Test	Result - Remark	Verdict
	- spacing ≥ 30 mm		N/A
	- screen withstanding test of 13.3.1		N/A
	- screen dimensions		N/A
	- no fiercely burning material		N/A
	- thermal protection		N/A
	- electronic circuits exempted		N/A
22.7 (4.15.2)	Luminaires made of thermoplastic material with lamp control gear		N/A
	a) construction		N/A
	b) temperature sensing control		N/A
	c) surface temperature		N/A
22.7 (4.16)	Luminaires for mounting on normally flammable surfaces		N/A
	No lamp control gear.....:	(compliance with Section 12)	N/A
22.7 (4.16.1)	Lamp control gear spacing:		N/A
	- spacing 35 mm		N/A
	- spacing 10 mm		N/A
22.7 (4.16.2)	Thermal protection:		N/A
	- in lamp control gear		N/A
	- external		N/A
	- fixed position		N/A
	- temperature marked lamp control gear		N/A
22.7 (4.16.3)	Design to satisfy the test of 12.6	(see clause 12.6)	N/A
22.7 (4.17)	Drain holes		N/A
	Clearance at least 5 mm		N/A
22.7 (4.18)	Resistance to corrosion		N/A
22.7 (4.18.1)	- rust-resistance		N/A
22.7 (4.18.2)	- season cracking in copper		N/A
22.7 (4.18.3)	- corrosion of aluminium		N/A





IEC 60598-2-22			
Clause	Requirement + Test	Result - Remark	Verdict
22.7 (4.19)	Igniters compatible with ballast		N/A
22.7 (4.20)	Rough service vibration		N/A
22.7 (4.21)	Protective shield		N/A
22.7 (4.21.1)	Shield fitted if tungsten halogen lamps or metal halide lamps		N/A
	Shield of glass if tungsten halogen lamps		N/A
22.7 (4.21.2)	Particles from a shattering lamp not impair safety		N/A
22.7 (4.21.3)	No direct path		N/A
22.7 (4.21.4)	Impact test on shield		N/A
	Glow-wire test on lamp compartment.....:	See Test Table 22.16 (13.3.2)	N/A
22.7 (4.22)	Attachments to lamps not cause overheating or damage		N/A
22.7 (4.23)	Semi-luminaires comply Class II		N/A
22.7 (4.24)	Photobiological hazards		P
22.7 (4.24.1)	No excessive UV radiation if tungsten halogen lamps and metal halide lamps (Annex P)		N/A
22.7 (4.24.2)	Retinal blue light hazard		P
	Class of risk group assessed according to IEC/TR 62778	RG0	—
	Luminaires with E_{thr} :		N/A
	a) Fixed luminaires		N/A
	- distance x m, borderline between RG1 and RG2... :		N/A
	- marking and instruction according 3.2.23		N/A
	b) Portable and handheld luminaires		N/A
	- marking according 3.2.23 if RG1 exceeded at 200 mm according to IEC/TR 62778		N/A
	Portable luminaires for children IEC 60598-2-10 and Mains socket outlet nightlights IEC 60598-2-12 not exceed RG1 at 200 mm according to IEC/62778		N/A
22.7 (4.25)	Mechanical hazard		P
	No sharp point or edges		P
22.7 (4.26)	Short-circuit protection		N/A





IEC 60598-2-22			
Clause	Requirement + Test	Result - Remark	Verdict
22.7 (4.26.1)	Adequate means of uninsulated accessible SELV parts		N/A
22.7 (4.26.2)	Short-circuit test with test chain according 4.26.3		N/A
	Test chain not melt through		N/A
	Test sample not exceed values of Table 12.1 and 12.2		N/A
22.7 (4.27)	Terminal blocks with integrated screwless earthing contacts		N/A
	Test according Annex V		N/A
	Pull test of terminal fixing (20 N)		N/A
	After test, resistance < 0,05 Ω		N/A
	Pull test of mechanical connection (50 N)		N/A
	After test, resistance < 0,05 Ω		N/A
	Voltage drop test, resistance < 0,05 Ω		N/A
22.7 (4.28)	Fixing of thermal sensing control		N/A
	Not plug-in or easily replaceable type		N/A
	Reliably kept in position		N/A
	No adhesive fixing if UV radiations from a lamp can degrade the fixing		N/A
	Not outside the luminaire enclosure		N/A
	Test of adhesive fixing:		N/A
	Max. temperature on adhesive material ($^{\circ}\text{C}$) :		—
	100 cycles between t min and t max		N/A
	Temperature sensing control still in position		N/A
22.7 (4.29)	Luminaires with non-replaceable light source		N/A
	Not possible to replace light source		N/A
	Live part not accessible after parts have been opened by hand or tools		N/A
22.7 (4.30)	Luminaires with non-user replaceable light source		P
	If protective cover provide protection against electric shock and marked with “caution, electric shock risk” symbol:		N/A
	Minimum two fixing means		P
22.7 (4.31)	Insulation between circuits		P





IEC 60598-2-22			
Clause	Requirement + Test	Result - Remark	Verdict
	Circuits insulated from LV supply fulfil requirements according 4.31.1 – 4.31.3		P
	Controllable luminaires requiring same level of insulation for all components, the insulation between control terminals and LV supply fulfil requirements according 4.31.1 – 4.31.3		P
22.7 (4.31.1)	SELV circuits		P
	Used SELV source		P
	Voltage \leq ELV		P
	Insulating of SELV circuits from LV supply		P
	Insulating of SELV circuits from other non SELV circuits		N/A
	Insulating of SELV circuits from FELV		N/A
	Insulating of SELV circuits from other SELV circuits		N/A
	SELV circuits insulated from accessible parts according Table X.1		P
	Plugs not able to enter socket-outlets of other voltage systems		N/A
	Socket outlets does not admit plugs of other voltage systems		N/A
	Plugs and socket-outlets does not have protective conductor contact		N/A
22.7 (4.31.2)	FELV circuits		N/A
	Used FELV source		N/A
	Voltage \leq ELV		N/A
	Insulating of FELV circuits from LV supply		N/A
	FELV circuits insulated from accessible parts according Table X.1		N/A
	Plugs not able to enter socket-outlets of other voltage systems		N/A
	Socket outlets does not admit plugs of other voltage systems		N/A
	Socket-outlets does not have protective conductor contact		N/A
22.7 (4.31.3)	Other circuits		N/A





IEC 60598-2-22			
Clause	Requirement + Test	Result - Remark	Verdict
	Other circuits insulated from accessible parts according Table X.1		N/A
	Class II construction with equipotential bonding for protection against indirect contacts with live parts:		N/A
	- conductive parts are connected together		N/A
	- test according 7.2.3		N/A
	- conductive part not cause an electric shock in case of an insulation fault		N/A
	- equipotential bonding in master/slave applications		N/A
	- master luminaire provided with terminal for accessible conductive parts of slave luminaires		N/A
	- slave luminaire constructed as class I		N/A
22.7 (4.32)	Overvoltage protective devices		N/A
	Comply with IEC 61643-11		N/A
	External to controlgear and connected to earth:		N/A
	- only in fixed luminaires		N/A
	- only connected to protective earth		N/A
22.7 (-)	Luminaire with automatic testing system complies with IEC 62034		N/A
	Specific items according IEC 61347-2-7 Annex K		N/A
22.7.1 (-)	No glow starters in circuit in start of or during the emergency mode		N/A
22.7.2 (-)	Lamp control gears comply with relevant part 2 of IEC 61347		P
22.7.3 (-)	Protective device disconnect luminaire in case of failure		P
22.7.4 (-)	Impact test min. 0,35 Nm		P
22.7.5 (-)	Circuit separation (self-contained lum.)		P
22.7.6 (-)	Circuit separation (centrally supplied lum.)		N/A
22.7.7 (-)	Charging device		P
	Indicator lamp and colour	Green	P
22.7.8 (-)	Battery meet requirements in Annex A	(see Annex A)	P
	Battery designed to provide duration for at least four years		P
	Battery only for emergency function		P





IEC 60598-2-22			
Clause	Requirement + Test	Result - Remark	Verdict
22.7.10 (-)	No switch in self-contained emergency luminaire between battery and emergency lighting lamps		P
	No switch in self-contained and central supplied emergency luminaire isolating emergency circuits from mains supply		P
	Installation according IEC 60364-5-56		P
22.7.11 (-)	Failure of lamp(s) not impair operation of the battery		P
22.7.12 (-)	Batteries in self-contained emergency luminaire comply with cl. 23 of IEC 61347-2-7 if applicable		P
22.7.13 (-)	No influence in emergency mode in self-contained emergency luminaire by short-circuit, contact to earth or interruption in normal supply wiring		P
22.7.14 (-)	Self-contained emergency luminaire with remote inhibiting and/or rest mode meet requirements of clause 25 of IEC 61347-2-7		N/A
22.7.19 (-)	Lamp voltage in self-contained emergency luminaire with tungsten filament lamps not exceed 1,05 rated voltage		N/A
22.7.20 (-)	Battery in self-contained emergency luminaire according manufacturers specification and Annex A		P
22.7.21 (-)	Batteries and chargers within self-contained emergency luminaire or in remote box		N/A
22.7.22 (-)	Remote box in self-contained emergency luminaire comply with same requirements as for the luminaire		N/A
22.7.23 (-)	Locking system for emergency luminaire on track system used for display lighting requires aid of tool		N/A

22.8 (11)	CREEPAGE DISTANCES AND CLEARANCES		P
22.8 (11.2.1)	Impulse withstand category (Normal category II)	Category II <input checked="" type="checkbox"/> Category III <input type="checkbox"/>	—
	Category III according Annex U		N/A
	Protected against pollution, reduced creepage and clearance according Annex P of IEC 61347-1		N/A
22.8 (11.2.2)	Creepage distances for frequency up to 30 kHz	See Test Table 22.8 (11.2) I	P
	Creepage distances for frequency over 30 kHz:		N/A
	- Controlgear marked with \hat{U}_{OUT} and f_{UOUT} according IEC 61347-1, clause 7.1, item w	See Test Table 22.8 (11.2) II	N/A





IEC 60598-2-22			
Clause	Requirement + Test	Result - Remark	Verdict
	- Requirements according IEC 60664-4 for controlgear not covered by IEC 61347	See Test Table 22.8 (11.2) II	N/A
22.8 (11.2.3)	Clearances for frequency up to 30 kHz	See Test Table 22.8 (11.2) I	P
	Clearances distances for frequency over 30 kHz:		N/A
	- Controlgear marked with U_P	See Test Table 22.8 (11.2) II	N/A
	- Requirements according IEC 60664-4 for controlgear not covered by IEC 61347	See Test Table 22.8 (11.2) II	N/A

22.9 (7)	PROVISION FOR EARTHING		N/A
22.9 (7.2.1 + 7.2.3)	Accessible metal parts		N/A
	Metal parts in contact with supporting surface		N/A
	Resistance < 0,5 Ω:		N/A
	Self-tapping screws used		N/A
	Thread-forming screws		N/A
	Thread-forming screw used in a grove		N/A
	Earth makes contact first		N/A
	Terminal blocks with integrated screwless earthing contacts tested according Annex V		N/A
	Protective earthing of the luminaire not via built-in control gear		N/A
22.9 (7.2.2 + 7.2.3)	Earth continuity in joints, etc.		N/A
22.9 (7.2.4)	Locking of clamping means		N/A
	Compliance with 4.7.3		N/A
	Terminal blocks with integrated screwless earthing contacts tested according Annex V		N/A
22.9 (7.2.5)	Earth terminal integral part of connector socket		N/A
22.9 (7.2.6)	Earth terminal adjacent to mains terminals		N/A
22.9 (7.2.7)	Electrolytic corrosion of the earth terminal		N/A
22.9 (7.2.8)	Material of earth terminal		N/A
	Contact surface bare metal		N/A
22.9 (7.2.10)	Class II luminaire for looping-in		N/A



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.

Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China

Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com

Scan code to check authenticity



IEC 60598-2-22			
Clause	Requirement + Test	Result - Remark	Verdict
	Double or reinforced insulation to functional earth		N/A
22.9 (7.2.11)	Earthing core coloured green-yellow		N/A
	Length of earth conductor		N/A
22.10 (14)	SCREW TERMINALS		N/A
	Separately approved; component list	(see Annex 1)	N/A
	Part of the luminaire	(see Annex 3)	N/A
22.10 (15)	SCREWLESS TERMINALS AND ELECTRICAL CONNECTIONS		P
	Separately approved; component list.....:	(see Annex 1)	P
	Part of the luminaire.....:	(see Annex 4)	N/A
22.11 (5)	EXTERNAL AND INTERNAL WIRING		P
22.11 (5.2)	Supply connection and external wiring		P
22.11 (5.2.1)	Means of connection.....:	Terminal block	P
	Outdoor luminaire has not PVC insulated external wiring if not class III or SELV ≤ 25 V a.c./60 V d.c. or protected from outdoor environment		N/A
22.11 (5.2.2)	Type of cable.....:		N/A
	Nominal cross-sectional area (mm ²).....:		N/A
	Cables equal to IEC 60227 or IEC 60245		N/A
22.11 (5.2.3)	Type of attachment, X, Y or Z		N/A
22.11 (5.2.5)	Type Z not connected to screws		N/A
22.11 (5.2.6)	Cable entries:		N/A
	- suitable for introduction		N/A
	- adequate degree of protection		N/A
22.11 (5.2.7)	Cable entries through rigid material have rounded edges		N/A





IEC 60598-2-22			
Clause	Requirement + Test	Result - Remark	Verdict
22.11 (5.2.8)	Insulating bushings:		N/A
	- suitably fixed		N/A
	- material in bushings		N/A
	- material not likely to deteriorate		N/A
	- tubes or guards made of insulating material		N/A
22.11 (5.2.9)	Locking of screwed bushings		N/A
22.11 (5.2.10)	Cord anchorage:		N/A
	- covering protected from abrasion		N/A
	- clear how to be effective		N/A
	- no mechanical or thermal stress		N/A
	- no tying of cables into knots etc.		N/A
	- insulating material or lining		N/A
22.11 (5.2.10.1)	Cord anchorage for type X attachment:		N/A
	a) at least one part fixed		N/A
	b) types of cable		N/A
	c) no damaging of the cable		N/A
	d) whole cable can be mounted		N/A
	e) no touching of clamping screws		N/A
	f) metal screw not directly on cable		N/A
	g) replacement without special tool		N/A
	Glands not used as anchorage		N/A
	Labyrinth type anchorages		N/A
22.11 (5.2.10.2)	Adequate cord anchorage for type Y and type Z attachment		N/A
22.11 (5.2.10.3)	Tests:		N/A
	- impossible to push cable; unsafe		N/A
	- pull test: 25 times; pull (N)..... :		N/A
	- torque test: torque (Nm)..... :		N/A
	- displacement ≤ 2 mm		N/A





IEC 60598-2-22			
Clause	Requirement + Test	Result - Remark	Verdict
	- no movement of conductors		N/A
	- no damage of cable or cord		N/A
	- function independent of electrical connection		N/A
22.11 (5.2.11)	External wiring passing into luminaire		N/A
22.11 (5.2.12)	Looping-in terminals		N/A
22.11 (5.2.13)	Wire ends not tinned		N/A
	Wire ends tinned: no cold flow		N/A
22.11 (5.2.14)	Mains plug same protection		N/A
	Class III luminaire plug		N/A
	No unsafe compatibility		N/A
22.11 (5.2.16)	Appliance inlets (IEC 60320)		N/A
	Installation couplers (IEC 61535)		N/A
	Other appliance inlet or connector according relevant IEC standard		N/A
22.11 (5.2.17)	No standardized interconnecting cables properly assembled		N/A
22.11 (5.2.18)	Used plug in accordance with		N/A
	- IEC 60083		N/A
	- other standard		N/A
22.11 (5.3)	Internal wiring		P
22.11 (5.3.1)	Internal wiring of suitable size and type		P
	Through wiring		N/A
	- not delivered/ mounting instruction		N/A
	- factory assembled		N/A
	- socket outlet loaded (A)..... : --		N/A
	- temperatures..... : (see Annex 2)		N/A
	Green- yellow for earth only		N/A





IEC 60598-2-22			
Clause	Requirement + Test	Result - Remark	Verdict
22.11 (5.3.1.1)	Internal wiring connected directly to fixed wiring		P
	Cross-sectional area (mm ²)..... : see Annex 1		P
	Insulation thickness		P
	Extra insulation added where necessary		N/A
22.11 (5.3.1.2)	Internal wiring connected to fixed wiring via internal current-limiting device		P
	Adequate cross-sectional area and insulation thickness		P
22.11 (5.3.1.3)	Double or reinforced insulation for class II		P
22.11 (5.3.1.4)	Conductors without insulation		N/A
22.11 (5.3.1.5)	SELV current-carrying parts		P
22.11 (5.3.1.6)	Insulation thickness other than PVC or rubber		N/A
22.11 (5.3.2)	Sharp edges etc.		P
	No moving parts of switches etc.		P
	Joints, raising/lowering devices		N/A
	Telescopic tubes etc.		N/A
	No twisting over 360°		P
22.11 (5.3.3)	Insulating bushings:		N/A
	- suitable fixed		N/A
	- material in bushings		N/A
	- material not likely to deteriorate		N/A
	- cables with protective sheath		N/A
22.11 (5.3.4)	Joints and junctions effectively insulated		N/A
22.11 (5.3.5)	Strain on internal wiring		N/A
22.11 (5.3.6)	Wire carriers		N/A





IEC 60598-2-22			
Clause	Requirement + Test	Result - Remark	Verdict
22.11 (5.3.7)	Wire ends not tinned		P
	Wire ends tinned: no cold flow		N/A
22.11 (5.4)	Test to determine suitability of conductors having a reduced cross-sectional area		N/A
	Under test the temperature of the luminaire wiring insulation not exceed the limits stated in Table 12.2	(see Annex 2)	N/A
	No damage to luminaire wiring after test		N/A
22.11.1 (-)	Permanently connected		N/A

22.12 (8)	PROTECTION AGAINST ELECTRIC SHOCK		P
22.12 (8.2.1)	Live parts not accessible		P
	Basic insulated parts not used on the outer surface without appropriate protection		P
	Basic insulated parts not accessible with standard test finger on portable, settable and adjustable luminaires		N/A
	Basic insulated parts not accessible with Ø 50 mm probe from outside, other types of luminaires		P
	Lamp and starterholders in portable and adjustable luminaires comply with double or reinforced insulation requirements		N/A
	Basic insulation only accessible under lamp or starter replacement		N/A
	Protection in any position		P
	Double-ended tungsten filament lamp		N/A
	Insulation lacquer not reliable		N/A
	Double-ended high pressure discharge lamp		N/A
	Relevant warning according to 3.2.18 fitted to the luminaire		N/A
22.12 (8.2.2)	Portable luminaire adjusted in most unfavourable position		N/A
22.12 (8.2.3.a)	Class II luminaire:		P
	- basic insulated metal parts not accessible during starter or lamp replacement		N/A





IEC 60598-2-22			
Clause	Requirement + Test	Result - Remark	Verdict
	- basic insulation not accessible other than during starter or lamp replacement		P
	- glass protective shields not used as supplementary insulation		N/A
22.12 (8.2.3.b)	BC lampholder of metal in class I luminaires shall be earthed		N/A
22.12 (8.2.3.c)	SELV circuits with exposed current carrying parts:		N/A
	Ordinary luminaire:		N/A
	- voltage under load (V).....: --		N/A
	- no-load voltage (V).....: --		N/A
	- touch current if applicable (mA): --		N/A
	One conductive part insulated if required		N/A
	Other than ordinary luminaire:		N/A
	- nominal voltage (V): --		N/A
	Class III luminaire only for connection to SELV		N/A
	Class III luminaire not provided with means for protective earthing		N/A
22.12 (8.2.4)	Portable luminaire have protection independent of supporting surface		N/A
22.12 (8.2.5)	Compliance with the standard test finger or relevant probe		P
22.12 (8.2.6)	Covers reliably secured		P
22.12 (8.2.7)	Luminaire other than below with capacitor > 0,5 μ F not exceed 50 V 1 min after disconnection	4V after 1min.	P
	Portable luminaire with capacitor > 0,1 μ F (0.25) not exceed 34 V 1 s after disconnection		N/A
	Other luminaires with capacitor > 0,1 μ F (0.25) with plug and track adaptors not exceed 60 V 5 s after disconnection		N/A

22.13 (12)	ENDURANCE TEST AND THERMAL TEST	P
22.13 (-)	If IP > IP 20 relevant test of (12.4), (12.5) and (12.6) after (9.2) before (9.3) specified in 22.14	—
22.13 (12.2)	Selection of lamps and ballasts	—





IEC 60598-2-22			
Clause	Requirement + Test	Result - Remark	Verdict
	Lamp used according Annex B	(Lamp used see Annex 2)	—
	Controlgear if separate and not supplied	(Controlgear used see Annex 2)	—
22.13 (12.3)	Endurance test:		P
	a) mounting- position	Normal used	—
	b) test temperature (°C).....	50°C	—
	c) total duration (h)	390h	—
	d) supply voltage (V).....	1.1x240VAC	—
	d) if not equipped with controlgear, constant voltage/current (V) or (A)	--	—
	e) luminaire ceases to operate		—
22.13 (12.3.2)	After endurance test:		P
	- no part unserviceable		P
	- luminaire not unsafe		P
	- no damage to track system		N/A
	- marking legible		P
	- no cracks, deformation etc.		P
22.13 (12.4)	Thermal test (normal operation)	(see Annex 2)	P
22.13 (12.5)	Thermal test (abnormal operation)		N/A
22.13 (12.6)	Thermal test (failed lamp control gear condition):		N/A
22.13 (12.6.1)	Through wiring or looping-in wiring loaded by a current of (A)	--	—
	- case of abnormal conditions.....	--	—
	- electronic lamp control gear		N/A
	- measured winding temperature (°C): at 1,1 Un	--	—
	- measured mounting surface temperature (°C) at 1,1 Un.....	--	N/A
	- calculated mounting surface temperature (°C)	--	N/A
	- track-mounted luminaires		N/A
22.13 (12.6.2)	Temperature sensing control		N/A





IEC 60598-2-22			
Clause	Requirement + Test	Result - Remark	Verdict
	- case of abnormal conditions.....:	--	—
	- thermal link		N/A
	- manual reset cut-out		N/A
	- auto reset cut-out		N/A
	- measured mounting surface temperature (°C).....:	--	N/A
	- track-mounted luminaires		N/A
22.13 (12.7)	Thermal test (failed lamp control gear in plastic luminaires):		N/A
22.13 (12.7.1)	Luminaire without temperature sensing control		N/A
22.13 (12.7.1.1)	Luminaire with fluorescent lamp ≤ 70W		N/A
	Test method 12.7.1.1 or Annex W	--	—
	Test according to 12.7.1.1:		N/A
	- case of abnormal conditions.....:	--	—
	- Ballast failure at supply voltage (V)	--	—
	- Components retained in place after the test		N/A
	- Test with standard test finger after the test		N/A
	Test according to Annex W:		N/A
	- case of abnormal conditions.....:	--	—
	- measured winding temperature (°C): at 1,1 Un.....:	--	—
	- measured temperature of fixing point/exposed part (°C): at 1,1 Un.....:	--	—
	- calculated temperature of fixing point/exposed part (°C).....:	--	—
	Ball-pressure test.....:	See Table 22.16 (13.2.1)	N/A
22.13 (12.7.1.2)	Luminaire with discharge lamp, fluorescent lamp > 70W, transformer > 10 VA		N/A
	- case of abnormal conditions.....:	--	—
	- measured winding temperature (°C): at 1,1 Un.....:	--	—
	- measured temperature of fixing point/exposed part (°C): at 1,1 Un.....:	--	—
	- calculated temperature of fixing point/exposed part (°C).....:	--	—





IEC 60598-2-22			
Clause	Requirement + Test	Result - Remark	Verdict
	Ball-pressure test.....:	See Table 22.16 (13.2.1)	N/A
22.13 (12.7.1.3)	Luminaire with short circuit proof transformers ≤ 10 VA		N/A
	- case of abnormal conditions.....:	--	—
	- Components retained in place after the test		N/A
	- Test with standard test finger after the test		N/A
22.13 (12.7.2)	Luminaire with temperature sensing control		N/A
	- thermal link.....:	Yes <input type="checkbox"/> No <input type="checkbox"/>	—
	- manual reset cut-out.....:	Yes <input type="checkbox"/> No <input type="checkbox"/>	—
	- auto reset cut-out.....:	Yes <input type="checkbox"/> No <input type="checkbox"/>	—
	- case of abnormal conditions.....:		—
	- highest measured temperature of fixing point/ exposed part (°C):.....:	--	—
	Ball-pressure test.....:	See Table 22.16 (13.2.1)	N/A
22.13.1 (-)	Endurance test for self-contained luminaire		P
	Operate satisfactory during 50 supply switching		P
22.13.2 (-)	Thermal test 12.4 to 12.5 in IEC 60598-1	(see Annex 2)	P
22.13.3 (-)	Condition of tests		P
22.13.4 (-)	Battery discharge		P
22.13.5 (-)	Reduced temperature		P
22.13.6 (-)	Additional thermal test	(see Annex 2)	P
22.13.7 (-)	Provide Vmin according Clause 20 of IEC 61347-2-7 at the end of operation		P

22.14 (9)	RESISTANCE TO DUST AND MOISTURE		P
22.14 (-)	The order of tests as specified in clause 22.12		P
22.14 (9.2)	Tests for ingress of dust, solid objects and moisture:		P
	- classification according to IP.....:	IP20	—
	- mounting position during test.....:	Normal mounting	—
	- fixing screws tightened; torque (Nm).....:	--	—
	- tests according to clauses.....:	Clause 9.2.0	—
	- electric strength test afterwards		P





IEC 60598-2-22			
Clause	Requirement + Test	Result - Remark	Verdict
	a) no deposit in dust-proof luminaire		N/A
	b) no talcum in dust-tight luminaire		N/A
	c) no trace of water on current-carrying parts or on insulation where it could become a hazard		N/A
	c.1) For luminaires without drain holes – no water entry		N/A
	c.2) For luminaires with drain holes – no hazardous water entry		N/A
	d) no water in watertight or pressure watertight luminaire		N/A
	e) no contact with live parts (IP 2X)		P
	e) no entry into enclosure (IP 3X and IP 4X)		N/A
	e) no contact with live parts through drain holes and ventilation slots (IP3X and IP4X)		N/A
	f) no trace of water on part of lamp requiring protection from splashing water		N/A
	g) no damage of protective shield or glass envelope		N/A
22.14 (9.3)	Humidity test 48 h	25°C, 93%RH	P
22.15 (10)	INSULATION RESISTANCE AND ELECTRIC STRENGTH		P
22.15 (10.2.1)	Insulation resistance test		P
	Cable or cord covered by metal foil or replaced by a metal rod of mm Ø	Metal foil used	—
	Insulation resistance (MΩ).....	See below	—
	SELV		P
	- between current-carrying parts of different polarity:		N/A
	- between current-carrying parts and mounting surface.....	>100 MΩ	P
	- between current-carrying parts and metal parts of the luminaire.....	>100 MΩ	P
	- between the outer surface of a flexible cord or cable where it is clamped in a cord anchorage and accessible metal parts.....		N/A
	- Insulation bushings as described in Section 5		N/A
	Other than SELV		P





IEC 60598-2-22			
Clause	Requirement + Test	Result - Remark	Verdict
	- between live parts of different polarity..... :	>100 MΩ	P
	- between live parts and mounting surface..... :	>100 MΩ	P
	- between live parts and metal parts..... :	>100 MΩ	P
	- between live parts of different polarity through action of a switch..... :		N/A
	- between the outer surface of a flexible cord or cable where it is clamped in a cord anchorage and accessible metal parts..... :		N/A
	- Insulation bushings as described in Section 5		N/A
22.15 (10.2.2)	Electric strength test		P
	Dummy lamp		N/A
	Luminaires with ignitors after 24 h test		N/A
	Luminaires with manual ignitors		N/A
	Test voltage (V)..... :	See below	P
	SELV		P
	- between current-carrying parts of different polarity:	--	N/A
	- between current-carrying parts and mounting surface..... :	500V	P
	- between current-carrying parts and metal parts of the luminaire..... :	500V	P
	- between the outer surface of a flexible cord or cable where it is clamped in a cord anchorage and accessible metal parts..... :		N/A
	- Insulation bushings as described in Section 5	--	N/A
	Other than SELV		P
	- between live parts of different polarity..... :	1480V	P
	- between live parts and mounting surface..... :	2960V	P
	- between live parts and metal parts..... :	2960V	P
	- between live parts and plastic enclosure..... :		N/A
	- between live parts of different polarity through action of a switch..... :	--	N/A
	- between the outer surface of a flexible cord or cable where it is clamped in a cord anchorage and accessible metal parts..... :	--	N/A
	- Insulation bushings as described in Section 5	--	N/A





IEC 60598-2-22			
Clause	Requirement + Test	Result - Remark	Verdict

22.15 (10.3)	Touch current or protective conductor current (mA):	0.102mA	P
-----------------	-----------------------------------------------------	---------	---

22.16 (13)	RESISTANCE TO HEAT, FIRE AND TRACKING		P
22.16 (13.2.1)	Ball-pressure test..... :	See Test Table 22.16 (13.2.1)	P
22.16 (13.3.1)	Needle-flame test (10 s)..... :	See Test Table 22.16 (13.3.1)	P
22.16 (13.3.2)	Glow-wire test (650°C)..... :	See Test Table 22.16 (13.3.2)	P
22.16 (13.4)	Proof tracking test (IEC 60112)..... :	See Test Table 22.16 (13.4)	P
22.16 (-)	Glow-wire test (850°C) if applicable	See Test Table 22.16 (13.3.2)	P
	Glow-wire test (850°C) or fire resistant cable if applicable		N/A

22.17 (-)	PHOTOMETRIC DATA		P
22.17.1 (-)	Intensity distribution data provided		P
22.17.2 (-)	If declared values in cd/1 000 lm, reference flux in emergency mode provided		N/A
22.17.3 (-)	At least 50% of level declared photometric data 5 s after failure of supply		P
	100% of level declared photometric data		P
	- after 60 s		P
	- after 0,5 s after failure of supply if high-risk task-area lighting		N/A
	Photometric measurements according CIE 121 SP1		P
	LED luminaires measurements according CIE S025		P
	All values at least minimum declared data		P
22.17.4 (-)	Colour-rendering index		P
22.17.5 (-)	Internally illuminated emergency safety sign meet requirements of ISO 30061		P
	Luminance of permanently illuminated safety sign meet requirements of ISO 3864-1 and ISO 3864-4		P
	Luminance measurements according Annex C	(see Annex C)	P





IEC 60598-2-22			
Clause	Requirement + Test	Result - Remark	Verdict
22.18 (-)	CHANGEOVER OPERATION		P
	Changeover device comply with Clause 21 of IEC 61347-2-7		P
22.19 (-)	HIGH TEMPERATURE OPERATION		P
	Operation at 70°C		P
	Relative light outputs		P
22.20 (-)	BATTERY CHARGERS FOR SELF-CONTAINED EMERGENCY LUMINAIRES		P
	Devices for recharging batteries comply with Clause 22 of IEC 61347-2-7		P
22.21 (-)	TEST DEVICES FOR EMERGENCY OPERATION		P
22.21.1 (-)	Self-contained luminaire provided with test facility		P
22.21.2 (-)	Remote testing device not influence proper function of safety illumination		N/A
22.21.3 (-)	Indicators colour according IEC 60073		P





IEC 60598-2-22			
Clause	Requirement + Test	Result - Remark	Verdict

22.8 (11.2)	TABLE I: Creepage distances and clearances						P
	Minimum distances (mm) for a.c. up to 30 kHz sinusoidal voltages						P
	Applicable part of IEC 60598-1 Table 11.1.A*, 11.1.B* and 11.2*						P
	Insulation type **	Measured clearance	Required		Measured creepage	Required	
			clearance	*Table		creepage	*Table
Distance 1:	B	>3.0	1.5	Table 11.1.B	>3.0	2.5	Table 11.1.A
Distance 2:	B	>8.0	1.5	Table 11.1.B	>8.0	2.5	Table 11.1.A
Distance 3:	B	>8.0	1.5	Table 11.1.B	>8.0	2.5	Table 11.1.A
Distance 4:	B	3.2	1.5	Table 11.1.B	3.2	2.5	Table 11.1.A
Distance 5:	B	2.8	1.5	Table 9	2.8	2.5	Table 7
Distance 6:	R	6.8	3.0	Table 9	6.8	5.0	Table 7
Distance 7:	R	6.8	3.0	Table 9	6.8	5.0	Table 7
Distance 8:	R	>7.0	3.0	Table 9	>7.0	5.0	Table 7
Distance 9:	R	>7.0	4.7	IEC61558-1	>7.0	5.0	IEC61558-1
Working voltage (V)..... :					Max. 240V		—
PTI..... :					< 600 ☒ ≥ 600 ☐		—
Pulse voltage or U_P if applicable (kV) :					--		—
Supplementary information: Distance 1: Between L and N on terminal block. Distance 2: Between live parts on terminal block and accessible metal parts or mounting surface. Distance 3: Between LED PCB board and accessible parts or mounting surface Distance 4: Between L and N before fuse Distance 5: Between pins of fuse Distance 6: Between Y capacitor (CY1) Distance 7: Between input circuits and output circuits on PCB board Distance 8: Between transformer core and secondary winding Distance 9: Between transformer Primary circuit trace to secondary circuit trace on PCB							

** Insulation type: B – Basic; S – Supplementary; R – Reinforced. See also IEC 60598-1 Annex M.





IEC 60598-2-22			
Clause	Requirement + Test	Result - Remark	Verdict

22.16 (13.2.1)	TABLE: Ball Pressure Test of Thermoplastics			P
Allowed impression diameter (mm):		2,0mm		—
Object/ Part No./ Material	Manufacturer/ trademark	Test temperature (°C)	Impression diameter (mm)	
Lamp cover	See Annex 1	75	1.0	
Plastic enclosure	See Annex 1	75	1.0	
PCB of driver	See Annex 1	125	0.8	
Bobbin of driver	See Annex 1	125	0.8	
Connector	See Annex 1	125	1.4	
Supplementary information:--				

22.16 (13.3.1)	TABLE: Needle-flame test (IEC 60695-11-5)				P
Object/ Part No./ Material	Manufacturer/ trademark	Duration of application of test flame (ta); (s)	Ignition of specified layer Yes/No	Duration of burning (tb) (s)	Verdict
Plastic enclosure	See Annex1	10s	No	0s	P
Lens	See Annex1	10s	No	0s	P
PCB	See Annex1	10s	No	0s	P
Bobbin	See Annex1	10s	No	0s	P
Connector	See Annex1	10s	No	0s	P
Supplementary information:--					

22.16 (13.3.2)	TABLE: Resistance to heat and fire - Glow wire tests						P
Object/ Part No./ Material	Manufacturer/ trademark	Glow wire test (°C)					Verdict
		650		750		850	
		te	ti	te	ti		
Plastic enclosure	See Annex 1	--	--	--	--	0s	P
Lens	See Annex 1	0s	0s	--	--	--	P
PCB	See Annex 1	0s	0s	--	--	--	P
Bobbin	See Annex 1	0s	0s	--	--	--	P
Connector	See Annex 1	0s	0s	--	--	--	P





IEC 60598-2-22			
Clause	Requirement + Test	Result - Remark	Verdict

Ignition of the specified layer placed underneath the test specimen (Yes/No).....:	No
Supplementary information:--	

22.16 (13.4)	TABLE: Proof tracking test (IEC 60112)				N/A
Test voltage PTI		175 V			—
Object/ Part No./ Material	Manufacturer/ trademark	Withstand 50 drops without failure on three places or on three specimens			Verdict
--	--	--	--	--	--
Supplementary information:					





IEC 60598-2-22			
Clause	Requirement + Test	Result - Remark	Verdict

	Annex A: Batteries for self-contained emergency luminaires		P
A.1	Type of batteries	Li-ion Battery	P
A.2	Battery conform to relevant standard	IEC 62133	P
	Luminaire operate within specific tolerances		P
A.3	Battery capacity		P
A.4	Sealed nickel cadmium batteries		N/A
A.4.1	Battery conform to IEC 61951-1		N/A
A.4.2.a	Maximum surface temperature of the battery °C..... :	--	N/A
A.4.2.b	Maximum overcharge rate 0,08 C ₅ A		N/A
A.4.2.c	Minimum ambient temperature of the cells 5 °C		N/A
A.4.2.d	Maximum discharge rates		N/A
A.5	Sealed nickel metal-hydride batteries		N/A
A.5.1	Battery conform to IEC 61951-2		N/A
A.5.2.a	Maximum case temperature of the battery °C..... :	--	N/A
A.5.2.b	Maximum overcharge rate 0,08 C ₅ A		N/A
A.5.2.c	Minimum ambient temperature of the cells 5 °C		N/A
A.5.2.d	Maximum discharge rates		N/A
A.6	Valve regulated lead acid batteries		N/A
A.6.1	Battery conform to relevant part of IEC 60869-21 or IEC 61056-1		N/A
A.6.2.a	Maximum surface temperature of the battery °C..... :	--	N/A
A.6.2.b	Maximum recharge current 0,4 C ₂₀		N/A
A.6.2.c	Maximum discharge rates		N/A
A.6.2.d	Maximum r.m.s. ripple current 0,1 C ₂₀		N/A
A.6.2.e	Minimum ambient temperature of the cells 5 °C		N/A
A.7	Ambient temperature of the cells measured after 48 h		N/A
A.8	Alternative operating parameters and evidence if operating outside limits in A.4 and A.5		N/A
A.9	Battery only replaced by a competent person		N/A





IEC 60598-2-22			
Clause	Requirement + Test	Result - Remark	Verdict

	Annex B: Luminaire classification		P
	Classified and marked according Annex B.....:	See the rating label	P

	Annex C: Luminance measurements		N/A
C.1	Contrast measurements		N/A
C.2	On site photometric tests		N/A
	according to Annex C of ISO 3864-4		N/A
	Measured values not less than specified in this standard		N/A

	Annex D: Rest mode and inhibition mode facilities		N/A
	The main characteristics of rest mode are:		N/A
	a) it can only be operated when the normal supply has failed, enabling battery capacity to be conserved if not needed		N/A
	b) the remote control wiring is fail-safe against short circuit, contact to earth or interruption		N/A
	c) at the restoration of the normal supply, the luminaire reverts to normal mode		N/A
	The main characteristics of inhibition mode are as follows:		N/A
	a) It can be set independently from the condition of the normal power and therefore when the building is unoccupied, a supply failure or disconnection will not cause an unwanted discharge		N/A
	b) The protection against the interruption of the wiring to the remote control should be provided by a proper installation according to the relevant wiring rules of IEC 60364-5-56 concerning safety services as follows:		N/A
	1) Circuits of safety services should be independent of other circuits		N/A
	2) Circuits of safety services should not pass through locations exposed to fire risk unless they are fire-resistant. The circuits should not in any case pass through zones exposed to explosion risk		N/A
	3) The protection against overload may be omitted		N/A





IEC 60598-2-22			
Clause	Requirement + Test	Result - Remark	Verdict
	4) Overcurrent protective devices should be used so as to avoid an overcurrent in one circuit impairing the correct operation of other circuits of safety services		N/A
	5) Switchgear and controlgear should be clearly identified and grouped in locations accessible only to competent persons		N/A
	6) Alarm devices should be clearly identified		N/A
	Annex E: Requirements for self-contained portable emergency luminaires		N/A
E.5	Classification of luminaires		N/A
	Base unit and portable emergency luminaires with mains-voltage supplied integrated charger of Class I or Class II		N/A
	Self-contained portable emergency luminaire without integrated mains-voltage supplied charger of Class III		N/A
E.5.1	Classified according construction		—
E.5.1.a	Control unit contained in the self-contained portable emergency luminaire	Yes <input type="checkbox"/> No <input type="checkbox"/>	—
E.5.1.b	Part of the control unit remains in the base unit	Yes <input type="checkbox"/> No <input type="checkbox"/>	—
E.5.2	Classified according operation		—
E.5.2.a	Automatic initiation with manual control	Yes <input type="checkbox"/> No <input type="checkbox"/>	—
E.5.2.b	Automatic initiation with automatic control	Yes <input type="checkbox"/> No <input type="checkbox"/>	—
E.5.2.c	Manual control	Yes <input type="checkbox"/> No <input type="checkbox"/>	—
E.5.3	Classified according photometric performance		—
	Distribution measured according IEC TR 61341		N/A
E.5.3.a	Narrow beam angels not greater than 15°		N/A
E.5.3.b	Medium beam angels between 15° and 25°		N/A
E.5.3.c	Wide beam angels greater than 25°		N/A
E.5.3.d	Variable beam angels – state the range of angels		N/A
E.6	Marking		N/A
E.6.1	Marking visible after installation		N/A
	Marking on both parts if separate charging device		N/A
	Class II symbol only on the charger if separate charging device		N/A



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.

Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China

Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com

Scan code to check authenticity



IEC 60598-2-22			
Clause	Requirement + Test	Result - Remark	Verdict
E.6.2	Instruction for electrical, mechanical and use according classification		N/A
E.6.3	Warning notice on both parts to return the luminaire to base unit for recharging after use		N/A
E.6.4	Instruction with photometric data		N/A
E.7	Construction		N/A
E.7.1	Control unit completely contained in the luminaire or part of the control unit in the base unit		N/A
E.7.2	Mechanical strength tests according 4.13 of IEC 60598-1		N/A
	Mechanical strength tests according 4.13.4 of IEC 60598-1 of portable section		N/A
E.7.3	Base unit permanently connected to unswitched supply		N/A
E.7.4	Integral manual switch used to switch the unit between inhibit mode and emergency mode and vice versa		N/A
	Recharging before supply voltage reach 0,85 times nominal value		N/A
E.7.5	Integral over current protection device connected immediately after the terminals connecting to the supply		N/A
E.7.6	Power supply connection between the luminaire and its base unit made without a tool		N/A
	Connecting devices according relevant standard		N/A
E.7.7	No access to live parts during or after connection or disconnection		N/A
E.7.8	Supply cable disconnected from the portable part before use		N/A
E.7.9	Connection between the portable part and the charger mechanically interlocked to prevent incorrect polarised connection		N/A
E.7.10	At least two independent replaceable lamps if incandescent lamps		N/A
E.7.11	Colour rendering index of any emergency lamps R_a 40 or better		N/A
E.7.12	Audible and/or visible warning on re-instatement of normal supply		N/A





IEC 60598-2-22			
Clause	Requirement + Test	Result - Remark	Verdict
E.7.13	Failure of the mains supply the luminaire operate in emergency mode or an indicator identify the location of the luminaire		N/A
	Load $\leq 0,01C5/h$ of the battery if indicator is used		N/A
E.7.14	Indicator give warning of low battery capacity remaining		N/A
E.7.15	Adequate stability		N/A
	Test at an angle of 15° to the horizontal		N/A
E.7.16	Adequate stability to illuminate the task area on non-horizontal surface		N/A
	Test at an angle of 15° to the horizontal		N/A
E.8	Changeover operation		N/A
	Requirements according 22.7.10 excluded if integral manual switch		N/A
	Design avoid switching of charger whilst holding the luminaire		N/A
E.9	High temperature operation		—
	Ambient temperature of 40°C in Clause 22.19		—
E.10	Thermal test		—
	Test made with portable part either placed on dull black painted wooden floor or rest against a dull black painted wooden wall		—



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.

Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China

Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com

Scan code to check authenticity



IEC 60598-2-22			
Clause	Requirement + Test	Result - Remark	Verdict

ANNEX 1	TABLE: Critical components information					P
Object / part No.	Code	Manufacturer/ trademark	Type / model	Technical data	Standard	Mark(s) of conformity ¹⁾
Plastic enclosure	C	CHI MEI CORPORATION	PC-6710(a)	PC,V-0,130℃	--	UL E56070
LED cover	C	CHI MEI CORPORATION	PC-6710(a)	PC,V-0,130℃	--	UL E56070
Terminal block	B	BJB GmbH & Co. KG	46.413	AC450V; T85; 24A/16A; 0,5...2,5mm²	DIN EN 60998-2-2	VDE 40034941
LED PCB	C	NINGBO KJPCB ELECTRONIC TECHNOLOGY CO LTD	KJ-02	V-0;;Max 1,5mm;130℃	--	UL E474795
LED	C	EVERLIGHT ELECTRONICS CO., LTD	SMD2835	Ra>80; Tc: 2700-6500K	IEC TR 62778	Tested with appliance
Input wire of driver	B	Xiangshan Fahua Electric Wire & Cable Co., Ltd.	H05V-U	1 x 0,75 mm²	VDE 0285-525-2-31	VDE 40031495
Plastic enclosure of driver	C	CHI MEI CORPORATION	PC-6710(a)	PC,V-0,130℃	--	UL E56070
Output wire of driver/ LED / Indicator	B	RUIAN XINZHOU WIRE & CABLE CO LTD	1015	18-24AWG; 600V,105℃	--	UL E308748
PCB	C	KINGBOARD LAMINATES HOLDINGS LTD	KB-5150 KB-5152	V-0	--	UL E123995
Fuse	B	Shenzhen Lanson Electronics Co. Ltd.	SMT T2A250V	250VAC; 2A	DIN EN 60127-1	VDE 40012592
X-cap	B	Dain Electronics Co., Ltd.	MEX	0,47uF Max, 275V/310V, 40/110/21	DIN EN 60384-14	VDE 40018798
Varistor	B	Hongzhi Enterprises Ltd.	HEL10D471K,	470V, 125℃	DIN EN 61051-1	VDE 40037512
Y-cap	B	Hongzhi Enterprises Ltd.	X1Y1	AC400V, 2200pF 125℃	DIN EN 60384-14	VDE 40038760
Winding	C	HANGZHOU WEIFENG ELECTRONIC CO LTD	MW 79-C	155℃	--	UL E229341
Bobbin	C	SUMITOMO BAKELITE CO LTD	PM-9820	150,V-0,	--	UL E41429
Triple insulation wire	B	Wuhu Ouyi Electronics Co., Ltd.	OLTIW-F	Class F	DIN EN 62368-1	VDE 40040893



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.
Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China
Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com
Scan code to check authenticity



IEC 60598-2-22						
Clause	Requirement + Test			Result - Remark		Verdict
Teflon Tube	C	CHANGYUAN ELECTRONICS (SHENZHEN) CO LTD	CB-TT-T CB-TT-L CB-TT-S	200°C	--	UL E180908
Insulation tape	C	Jingjiang Yahua Pressure Sensitive Glue Co Ltd	CT-280, PZ	130 degree C	--	UL:E165111
Connector (white)	C	NEO-NEON LED LIGHTING INTERNATIONAL LTD	YY-058	PVC; V-0	--	UL E201139
Connector (black/red)	C	CWB GROUP CO LTD	VH-2A	300VAC; 10A	--	UL E200881
Opto-coupler	B	Everlight Electronics Co., Ltd.	CNY64	110°C, reinforced insulation>=9.7 mm	IEC 60474-5-5	VDE 40027351
Battery	B	Shangdong zhongxin Dison Power Supply Co.,Ltd	IFR 18650-1.6Ah	3.2V, 1600mAh, 2pcs	IEC 62133-2	JPTUV-098723
Test switch	C	SHENZHEN HONGJU ELECTRONICS CO.,LTD	PB-05B	3A,125V	IEC 61058.1	Tested with appliance

Supplementary information:

¹⁾ Provided evidence ensures the agreed level of compliance. See OD-CB2039.

The codes above have the following meaning:

- A - The component is replaceable with another one, also certified, with equivalent characteristics
- B - The component is replaceable if authorised by the test house
- C - Integrated component tested together with the appliance
- D - Alternative component



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.

Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China

Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com

Scan code to check authenticity



IEC 60598-2-22

Clause	Requirement + Test	Result - Remark	Verdict
--------	--------------------	-----------------	---------

ANNEX 2	TABLE: Temperature measurements, thermal tests of Section 12		P			
	Type reference.....:	DS-ES-04M	—			
	Lamp used.....:	LED lamp	—			
	Lamp control gear used.....:	Internal LED driver	—			
	Mounting position of luminaire.....:	Mounting acc. to user manual	—			
	Supply wattage (W).....:	See below	—			
	Supply current (A).....:	See below	—			
	Calculated power factor.....:	See below	—			
	Table: measured temperatures corrected for ta = 40 °C:		P			
	- abnormal operating mode.....:	Replacement of batteries with a short-circuit link across the battery charger output: the batteries is unit shut down.	—			
	- test 1: rated voltage.....:	--	—			
	- test 2: 1,06 times rated voltage or 1,05 times rated wattage.....:	a, Charge mode: 1.06x240V=254.4V(0.051A, 5.75W, 0.441PF); b, Discharge mode: 6.55VDC, 0.249A, 1.63W	—			
	- test 3: Load on wiring to socket-outlet, 1,06 times voltage or 1,05 times wattage.....:	--	—			
	- test 4: 1,1 times rated voltage or 1,05 times rated wattage.....:	--	—			
	Through wiring or looping-in wiring loaded by a current of A during the test	--	—			
Temperature measurements, (°C)						
Part	Clause 12.4 – normal				Clause 12.5 – abnormal	
	test 1	test 2a normal operating mode	test 2b emergency lighting mode	limit	test 4	limit
Terminal block	--	44.0	41.0	85	--	--
Input wire of driver	--	46.5	41.3	90	--	--
L1 winding	--	56.3	41.1	150	--	--
L1 bobbin	--	53.5	41.5	155	--	--





IEC 60598-2-22						
Clause	Requirement + Test			Result - Remark		Verdict
X-cap(CX1)	--	54.4	41.6	110	--	--
C15	--	56.5	41.4	105	--	--
L2	--	57.7	41.7	150	--	--
T1 winding	--	58.9	41.5	150	--	--
T1 bobbin	--	58.2	41.3	155	--	--
CY1	--	57.1	41.0	125	--	--
Driver PCB	--	54.3	40.8	130	--	--
CN4	--	45.0	40.5	130	--	--
CN5	--	44.8	40.4	130	--	--
Wire for battery	--	43.5	41.4	105	--	--
Battery surface	--	45.4	43.2	55	--	--
Wire near LED	--	45.2	43.4	105	--	--
LED PCB	--	46.2	44.3	130	--	--
Lamp cover	--	41.1	40.8	130	--	--
Mounting surface	--	41.7	40.7	90	--	--
Ambient	--	40.0	40.0	--	--	--

ANNEX 2	TABLE: Temperature measurements, thermal tests of Section 12		P
	Type reference.....:	DS-ES-03M	—
	Lamp used.....:	LED lamp	—
	Lamp control gear used.....:	Integral LED driver	—
	Mounting position of luminaire.....:	Mounting acc. to user manual	—
	Supply wattage (W).....:	See below	—
	Supply current (A).....:	See below	—
	Calculated power factor.....:	See below	—
	Table: measured temperatures corrected for $t_a = 40^\circ\text{C}$:		P
	- abnormal operating mode.....:	Replacement of batteries with a short-circuit link across the battery charger output: the batteries is unit shut down.	—
	- test 1: rated voltage.....:	--	—





IEC 60598-2-22			
Clause	Requirement + Test	Result - Remark	Verdict

	- test 2: 1,06 times rated voltage or 1,05 times rated wattage..... :	a, Charge mode: 1.06x240V=254.4V(0.052A, 5.64W, 0.423PF); b, Discharge mode: 6.61VDC, 0.291A, 1.92W	—
	- test 3: Load on wiring to socket-outlet, 1,06 times voltage or 1,05 times wattage..... :	--	—
	- test 4: 1,1 times rated voltage or 1,05 times rated wattage..... :	--	—
	Through wiring or looping-in wiring loaded by a current of A during the test	--	—

Temperature measurements, (°C)

Part	Clause 12.4 – normal				Clause 12.5 – abnormal	
	test 1	test 2a normal operating mode	test 2b emergency lighting mode	limit	test 4	limit
Terminal block	--	44.5	42.2	85	--	--
Input wire of driver	--	47.2	43.5	90	--	--
L1 winding	--	56.1	44.2	150	--	--
L1 bobbin	--	53.4	43.7	155	--	--
X-cap(CX1)	--	54.8	42.6	110	--	--
C15	--	56.7	42.5	105	--	--
L2	--	57.5	42.6	150	--	--
T1 winding	--	58.6	42.8	150	--	--
T1 bobbin	--	57.1	41.7	155	--	--
CY1	--	56.5	41.9	125	--	--
Driver PCB	--	54.1	43.8	130	--	--
CN4	--	47.2	41.0	130	--	--
CN5	--	46.9	41.2	130	--	--
Wire for battery	--	46.0	43.1	105	--	--
Battery surface	--	47.6	46.0	55	--	--
Wire near LED	--	48.9	47.5	105	--	--
LED PCB	--	50.6	48.9	130	--	--





IEC 60598-2-22						
Clause	Requirement + Test			Result - Remark		Verdict
Lamp cover	--	44.3	43.7	130	--	--
Mounting surface	--	43.3	41.5	90	--	--
Ambient	--	40.0	40.0	--	--	--

ANNEX 2	TABLE: Temperature measurements, thermal tests of Section 12				P	
	Type reference.....:	DS-ES-01M			—	
	Lamp used.....:	LED lamp			—	
	Lamp control gear used.....:	Integral LED driver			—	
	Mounting position of luminaire.....:	Mounting acc. to user manual			—	
	Supply wattage (W).....:	See below			—	
	Supply current (A)..... :	See below			—	
	Calculated power factor.....:	See below			—	
	Table: measured temperatures corrected for ta = 40 °C:				P	
	- abnormal operating mode.....:	Replacement of batteries with a short-circuit link across the battery charger output: the batteries is unit shut down.			—	
	- test 1: rated voltage.....:	--			—	
	- test 2: 1,06 times rated voltage or 1,05 times rated wattage.....:	a, Charge mode: 1.06x240V=254.4V(0.05A, 5.54W, 0.43PF); b, Discharge mode: 6.54VDC, 0.270A, 1.77W			—	
	- test 3: Load on wiring to socket-outlet, 1,06 times voltage or 1,05 times wattage..... :	--			—	
	- test 4: 1,1 times rated voltage or 1,05 times rated wattage.....:	--			—	
	Through wiring or looping-in wiring loaded by a current of A during the test :	--			—	
Temperature measurements, (°C)						
Part	Clause 12.4 – normal				Clause 12.5 – abnormal	
	test 1	test 2a normal operating mode	test 2b emergency lighting mode	limit	test 4	limit





IEC 60598-2-22						
Clause	Requirement + Test			Result - Remark		Verdict
Battery surface	--	46.8	43.5	55	--	--
Wire near LED	--	48.3	45.7	105	--	--
LED PCB	--	50.8	47.9	130	--	--
Lamp cover	--	46.4	42.9	130	--	--
Mounting surface	--	43.1	41.6	90	--	--
Ambient	--	40.0	40.0	--	--	--



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.

Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China

Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com

Scan code to check authenticity



IEC 60598-2-22			
Clause	Requirement + Test	Result - Remark	Verdict

ANNEX 3	Screw terminals (part of the luminaire)		N/A
(14)	SCREW TERMINALS		N/A
(14.2)	Type of terminal..... :		—
	Rated current (A)..... :		—
(14.3.2.1)	One or more conductors		N/A
(14.3.2.2)	Special preparation		N/A
(14.3.2.3)	Terminal size		N/A
	Cross-sectional area (mm ²)..... :		—
(14.3.3)	Conductor space (mm)..... :		N/A
(14.4)	Mechanical tests		N/A
(14.4.1)	Minimum distance		N/A
(14.4.2)	Cannot slip out		N/A
(14.4.3)	Special preparation		N/A
(14.4.4)	Nominal diameter of thread (metric ISO thread)..... :	M	N/A
	External wiring		N/A
	No soft metal		N/A
(14.4.5)	Corrosion		N/A
(14.4.6)	Nominal diameter of thread (mm)..... :		N/A
	Torque (Nm)..... :		N/A
(14.4.7)	Between metal surfaces		N/A
	Lug terminal		N/A
	Mantle terminal		N/A
	Pull test; pull (N)..... :		N/A
(14.4.8)	Without undue damage		N/A

ANNEX 4	Screwless terminals (part of the luminaire)		N/A
(15)	SCREWLESS TERMINALS		N/A
(15.2)	Type of terminal..... :		—
	Rated current (A)..... :		—
(15.3.1)	Material		N/A





IEC 60598-2-22			
Clause	Requirement + Test	Result - Remark	Verdict
(15.3.2)	Clamping		N/A
(15.3.3)	Stop		N/A
(15.3.4)	Unprepared conductors		N/A
(15.3.5)	Pressure on insulating material		N/A
(15.3.6)	Clear connection method		N/A
(15.3.7)	Clamping independently		N/A
(15.3.8)	Fixed in position		N/A
(15.3.10)	Conductor size		N/A
	Type of conductor		N/A
(15.5)	Terminals and connections for internal wiring		N/A
(15.5.1)	Mechanical tests		N/A
(15.5.1.1.1)	Pull test spring-type terminals (4 N, 4 samples).....:		N/A
(15.5.1.1.2)	Pull test pin or tab terminals (4 N, 4 samples).....:		N/A
	Insertion force not exceeding 50 N		N/A
(15.5.1.2)	Permanent connections: pull-off test (20 N)		N/A
(15.5.2)	Electrical tests		N/A
	Voltage drop (mV) after 1 h (4 samples).....:		N/A
	Voltage drop of two inseparable joints		N/A
	Number of cycles:		—
	Voltage drop (mV) after 10th alt. 25th cycle (4 samples).....:		N/A
	Voltage drop (mV) after 50th alt. 100th cycle (4 samples).....:		N/A
	After ageing, voltage drop (mV) after 10th alt. 25th cycle (4 samples).....:		N/A
	After ageing, voltage drop (mV) after 50th alt. 100th cycle (4 samples).....:		N/A
(15.6)	Terminals and connections for external wiring		N/A
(15.6.1)	Conductors		N/A
	Terminal size and rating		N/A
15.6.2	Mechanical tests		N/A
(15.6.2.1)	Pull test spring-type terminals or welded connections (4 samples); pull (N)		N/A





IEC 60598-2-22			
Clause	Requirement + Test	Result - Remark	Verdict

(15.6.2.2)	Pull test pin or tab terminals (4 samples); pull (N)		N/A
(15.6.3)	Electrical tests		N/A
	Tests according 15.6.3.1 + 15.6.3.2 in IEC 60598-1		N/A

(15.6.3.1) (15.6.3.2)	TABLE: Contact resistance test / Heating tests										N/A
Voltage drop (mV) after 1 h											—
terminal	1	2	3	4	5	6	7	8	9	10	
voltage drop (mV)											
Voltage drop of two inseparable joints											N/A
Voltage drop after 10th alt. 25th cycle											N/A
Max. allowed voltage drop (mV).....:											—
terminal	1	2	3	4	5	6	7	8	9	10	
voltage drop (mV)											
Voltage drop after 50th alt. 100th cycle											N/A
Max. allowed voltage drop (mV).....:											—
terminal	1	2	3	4	5	6	7	8	9	10	
voltage drop (mV)											
Continued ageing: voltage drop after 10th alt. 25th cycle											N/A
Max. allowed voltage drop (mV).....:											—
terminal	1	2	3	4	5	6	7	8	9	10	
voltage drop (mV)											
Continued ageing: voltage drop after 50th alt. 100th cycle											N/A
Max. allowed voltage drop (mV).....:											—
terminal	1	2	3	4	5	6	7	8	9	10	
voltage drop (mV)											
Supplementary information:--											

	ANNEX 5: EMF test result according to IEC 62493	P
4	LIMITS	P
4.1	General	P





IEC 60598-2-22			
Clause	Requirement + Test	Result - Remark	Verdict
	Comply with Van der Hoofden test limit in 4.2.3 or inherently compliant in 4.2.2 and pass assessment procedure for intentional radiators in 4.3		P
4.2	Unintentional radiating part of lighting equipment		P
4.2.2	Lighting equipment deemed to comply with the Van der Hoofden test without testing		P
	1) electronic controlgear	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	—
	2) incandescent-lamp technology	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	—
	3) LED-light-source technology	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>	—
	4) OLED-light-source technology	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	—
	5) high-pressure discharge lamp LED-light-source technologies	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	—
	6) low-pressure discharge lamp technologies with exposure distance ≥ 50 cm	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	—
	7) independent auxiliary	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	—
	Not fulfil any of 1-7 above subject to 4.2.3		—
4.2.3	Applications of limits		N/A
	Not fulfil any of 1-7 in 4.2.2 but the compliance factor F is ≤ 1		N/A
4.3	Intentional radiating part of lighting equipment		N/A
	Comply with one of methods in Clause 7 if intentional radiator		N/A
6	MEASUREMENT PROCEDURE FOR THE VAN DER HOOFDEN TEST		N/A
6.1	General		N/A
	Measurements carried out under conditions according Clause 6.1 – 6.6	See Table 6	N/A
7	ASSESSMENT PROCEDURE INTENTIONAL RADIATORS		N/A
7.2	Low-power exclusion method		N/A
7.2.1	Input $P_{\text{int,rad}}$:		—
	Exclusion level P_{max}:		—
	Input power $P_{\text{int,rad}} < \text{exclusion level } P_{\text{max}}$		N/A
7.3	Application of the EMF product standard for body worn-equipment		N/A
	If not Clause 7.2 is met and expose distance ≤ 0.05 m, comply with IEC 62209-2		N/A





IEC 60598-2-22						
Clause	Requirement + Test			Result - Remark	Verdict	
7.4	Application of the EMF product standard for base stations				N/A	
	If not Clause 7.2 is met and if intentional radiator is base station, comply with IEC 62232				N/A	
7.5	Application of another EMF standard				N/A	
	If not Clause 7.2 is met and if intentional radiator cannot be considered as in Clause 7.3 or 7.4, comply with IEC 62311				N/A	
6	TABLE: Measurement results with Van der Hoofden test head				N/A	
Location of EUT		Test model	Measuring distance	Result(F)	Limit(F)	Verdict
Reference Annex B of IEC 62493:2015		--	--	--	≤1.0	N/A



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.

Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China

Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com

Scan code to check authenticity



Attachment No.1

IEC 60598_2_22F-ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict

ATTACHMENT TO TEST REPORT IEC 60598-2-22
EUROPEAN GROUP DIFFERENCES AND NATIONAL DIFFERENCES
Luminaires

Part 2: Particular requirements

Section 22: LUMINAIRES FOR EMERGENCY LIGHTING

Differences according to..... : EN 60598-2-22:2014+A1:2020 used in conjunction with
EN IEC 60598-1:2021

	CENELEC COMMON MODIFICATIONS (EN)	P
--	------------------------------------------	----------

22.6 (3)	MARKING	N/A
22.6 (3.3.101)	For luminaires not supplied with terminal block: Adequate warning on the package	N/A

22.7 (4)	CONSTRUCTION	N/A
3.6 (4.11.6)	Electro-mechanical contact systems	N/A

22.7 (5)	EXTERNAL AND INTERNAL WIRING	P
22.7 (5.2.1)	Connecting leads	N/A
	- without a means for connection to the supply	N/A
	- terminal block specified	N/A
	- relevant information provided	N/A
	- compliance with 4.6, 4.7.1, 4.7.2, 4.10.1, 11.2, 12 and 13.2 of Part 1	N/A
22.7 (5.2.2)	Cables equal to EN 50525	P
	Replace table 5.1 – Supply cord	P

22.13 (12)	ENDURANCE TESTS AND THERMAL TESTS	P
22.13 (12.4.2c)	Thermal test (normal operation) see footnote c to table 12.2 relating to unsleeved fixed wiring	P



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.
Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District,
Shenzhen, China
Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com
Scan code to check authenticity



Attachment No.1

IEC 60598_2_22F-ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
ZB	ANNEX ZB, SPECIAL NATIONAL CONDITIONS (EN)		N/A
(3.3)	DK: power supply cords of class I luminaires with label		N/A
(4.5.1)	DK: socket-outlets		N/A
(5.2.1)	CY, DK, FI, GB: type of plug		N/A
ZC	ANNEX ZC, NATIONAL DEVIATIONS (EN)		N/A
(4 & 5)	FR: Shuttered socket-outlets 10/16A		N/A
	FR: Safety requirements for high buildings (Arrêté du 30 décembre 2011 portant règlement de sécurité pour la construction des immeubles de grande hauteur et leur protection contre les risques d'incendie et de panique; Section VIII; Article GH 48, Eclairage) Glow-wire test for outer parts of luminaires:		N/A
	- 850°C for luminaires in stairways and horizontal travel paths		N/A
	- 650°C for indoor luminaires		N/A
(13.3)	GB: Requirements according to United Kingdom Building Regulation		N/A



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.
Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China
Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com
Scan code to check authenticity



Attachment No.2

IEC 62031 LED modules for general lighting - Safety specifications			
Clause	Requirement + Test	Result - Remark	Verdict
4.2	Classification		---
	Built-in.....:	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	—
	Independent.....:	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	—
	Integral.....:	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>	—
4.6	Independent modules comply with requirements in IEC 60598-1:2020		N/A
4.8	Modules with integrated controlgear providing SELV comply with requirements according to IEC 61347-1:2015/AMD1:2017 clause L.5 to L.11.	(see Annex 1)	N/A
6	Marking		N/A
6.2	Contents of marking for built-in and for independent LED modules		N/A
6.3	Location of marking for built-in LED modules		N/A
6.4	Location of marking for independent LED modules		N/A
6.5	Marking of integral LED modules		P
6.6	Durability and legibility of marking		N/A
7	Terminals		N/A
8 (9)	EARTHING		N/A
9 (10)	Protection against accidental contact with live parts		N/A
10 (11)	Moisture resistance and insulation		P
11 (12)	Electric strength		P
12 (14)	Fault conditions		P
12.1	Fault conditions according to IEC 61347-1, Clause 14		P
12.2	Overpower condition	No damage	P
14 (15)	Construction		P
- (15.1)	Wood, cotton, silk, paper and similar fibrous material		P
	Wood, cotton, silk, paper and similar fibrous material not used as insulation		P
- (15.2)	Printed circuits		P



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.

Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China

Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com

Scan code to check authenticity



Attachment No.2

IEC 62031 LED modules for general lighting - Safety specifications			
Clause	Requirement + Test	Result - Remark	Verdict
	Printed circuits used as internal connections complies with clause 14		P
15 (16)	Creepage distances and clearances		N/A
16 (17)	Screws, current-carrying parts and connections		N/A
17 (18)	Resistance to heat, fire and tracking		N/A
18	Resistance to corrosion		N/A
20	Heat management		N/A
22	Photobiological safety		P
22.1	UV radiation		N/A
22.2	Blue light hazard		P
	Assessed according to IEC TR 62778		P
22.3	Infrared radiation		N/A



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.
Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China
Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com
Scan code to check authenticity



Attachment No.3

IEC TR 62778 Photobiological safety of lamps and lamp systems			
Clause	Requirement + Test	Result - Remark	Verdict

	Spectroradiometric measurement (IEC TR 62778:2014)				P
	Measurement performed on:		Luminaire		--
	Model number.....:		DS-ES-04M		--
	Test voltage (V).....:		240VAC		--
	Test current (mA).....:		--		--
	Test frequency (Hz).....:		--		--
	Ambient, t (°C).....:		25,0		--
	Measurement distance..... :		<input checked="" type="checkbox"/> 20 cm <input type="checkbox"/> ... cm		--
	Source size		<input checked="" type="checkbox"/> Non-small <input type="checkbox"/> Small : mm		--
	Field of view		<input type="checkbox"/> 100 mrad <input checked="" type="checkbox"/> 11 mrad <input type="checkbox"/> 1,7 mrad (for small sources)		--
Item		Symbol	Units	Result	Risk Group
Correlated colour temperature		CCT	K	--	--
x/y colour coordinates		--	--	--	--
Blue light hazard radiance		L _B	W/(m²•sr¹)	<1.0	<input checked="" type="checkbox"/> RG0: <100 <input type="checkbox"/> RG1: <10000 <input type="checkbox"/> RG2: <4000000
Blue light hazard irradiance		E _B	W/m²	--	--
Luminance		L	cd/m²	--	--
Illuminance		E	lx	--	--
Supplementary information:					



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.
Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China
Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com
Scan code to check authenticity



Attachment No.4

IEC/EN 61347-2-7			
Clause	Requirement + Test	Result - Remark	Verdict
4 (4)	GENERAL REQUIREMENTS		P
- (4)	Insulation materials for double or reinforced insulation according requirements in Annex N of IEC 61347-1	(see Annex N)	N/A
- (4)	Compliance of independent controlgear enclosure with IEC 60598- 1		N/A
- (4)	Built-in magnetic ballast with double or reinforced insulation comply with Annex I of IEC 61347-1		N/A
- (4)	Built-in electronic controlgear with double or reinforced insulation comply with Annex O of IEC 61347-1	(see Annex O)	N/A
- (4)	SELV controlgear comply with Annex L of IEC 61347-1	(see Annex L)	P
4 (-)	Each lamp type tested according clause 15 – 20, 22 and 34 and lamp with highest rated power in other tests		—
4 (-)	Controlgear with automatic test function tested according Annex K	(see Annex K)(for automatic test function.)	P
6 (6)	CLASSIFICATION		P
	Built-in controlgear	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	—
	Independent controlgear.....	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	—
	Integral controlgear	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>	—
	With automatic test function	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	—
7 (7)	MARKING		N/A
7.1 (7.1)	Mandatory markings		N/A
	a) mark of origin		N/A
	b) model number or type reference		N/A
	c) symbol for independent controlgear, if applicable		N/A





Attachment No.4

IEC/EN 61347-2-7			
Clause	Requirement + Test	Result - Remark	Verdict
	d) correlation between interchangeable parts and controlgear marked		N/A
	e) rated supply voltage (V)		N/A
	supply frequency (Hz)		N/A
	supply current (A)		N/A
	f) earthing symbol		N/A
	k) wiring diagram		N/A
	l) value of t_c		N/A
7.1 (-)	- open circuit voltage (V)		N/A
	- controlgear without enclosure marked with a) and b) above		N/A
	- type and current rating of fuse, if applicable		N/A
	- symbol if the controlgear comply with this part 2	EL	N/A
	- symbol if the controlgear is provided with automatic test function	EL-T	N/A
	- maximum working voltage between output terminals (V)		N/A
	- maximum working voltage between any output terminal and earth, if applicable (V)		N/A
7.1 (7.2)	Marking durable and legible		N/A
	Rubbing 15 s water, 15 s petroleum; marking legible		N/A
7.2 (7.1)	Information to be provided, if applicable:		N/A
	h) declaration on protection against accidental contact		N/A
	i) cross-section of conductors (mm ²)		N/A
	j) number, type and wattage of lamp(s)		N/A
	n) additional heat sink		N/A
	- suitable for use only on battery supply not having a trickle or intermittent re-charging circuits		N/A
	- rated duration of operation (hr)		N/A
	- for use in luminaries for high-risk task area lighting		N/A





Attachment No.4

IEC/EN 61347-2-7			
Clause	Requirement + Test	Result - Remark	Verdict
	- proof against supply voltage polarity reversal		N/A
	- emergency ballast lumen factor (EBLF)		N/A
	- limits of ambient temperature range within which the ballast will start and operate		N/A
	- type of insulation between the supply and the battery circuit (non, basic or double/reinforced)		N/A
	- recharge the battery normally after the test of 22.3		N/A
	- supply current for each lamp		N/A
	Information for correct battery selection:		N/A
	- technology of the battery		N/A
	- type designation		N/A
	- capacity		N/A
	- voltage		N/A
	- maximum charge current		N/A
	- minimum charge current		N/A
	- charge voltage limits		N/A
	- maximum discharge current		N/A
	- minimum discharge current		N/A
	- discharge voltage limits		N/A
	- temperature rating		N/A
	- type and manufacturer		N/A
	- information regarding the installation, commissioning and use if with automatic test function		N/A
8 (10)	PROTECTION AGAINST ACCIDENTAL CONTACT WITH LIVE PARTS		P
- (10.1)	Controlgear protected against accidental contact with live parts	Rely on the enclosure of luminaire	N/A
- (A2)	Voltage measured with 50 kΩ		N/A
- (A3)	Voltage > 35 V peak or > 60 V d.c. or protective impedance device	(see Annex A)	N/A



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.

Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China

Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com

Scan code to check authenticity



Attachment No.4

IEC/EN 61347-2-7			
Clause	Requirement + Test	Result - Remark	Verdict
- (10.1)	Lacquer or enamel not used for protection or insulation		N/A
	Adequate mechanical strength on parts providing protection		N/A
- (10.2)	Capacitors > 0,5 μ F: voltage after 1 min (V): < 50 V	4V	P
- (10.3)	Controlgear providing SELV		P
	Accessible conductive parts are insulated from live parts by double or reinforced insulation in SELV controlgear		P
	No connection between output circuit and the body or protective earthing circuit		N/A
	No possibility of connection between output circuit and the body or protective earthing circuit through other conductive parts		N/A
	SELV outputs separated by at least basic insulation		P
	ELV conductive parts insulated as live parts		P
	Tests according Annex L of IEC 61347-1		P
- (10.4)	Accessible conductive parts in SELV circuits		P
	Output voltage under load ≤ 25 V r.m.s. or ≤ 60 V d.c.		P
	If output voltage > 25 V r.m.s. or > 60 V d.c.; No load output ≤ 35 V peak or ≤ 60 V d.c and touch current does not exceed 0,7 mA (peak) or 2 mA d.c.	--	N/A
	One conductive part is insulated if output voltage or current exceeding the values above and withstand test voltage 500 V		N/A
	Double or reinforced insulation bridged by appropriate and at least two resistors or two Y2 capacitors or one Y1 capacitor	Y1 type capacitor	P
	Y1 or Y2 capacitors comply with IEC 60384-14		P





Attachment No.4

IEC/EN 61347-2-7			
Clause	Requirement + Test	Result - Remark	Verdict
	Resistors comply with test (a) in 14.1 of IEC 60065		N/A
9 (8)	TERMINALS		N/A
- (8)	Screw terminals according section 14 of IEC 60598-1:		N/A
	Separately approved; component list	(see Annex 1)	N/A
	Part of the controlgear	(see Annex 2)	N/A
	Screwless terminals according section 15 of IEC 60598-1:		N/A
	Separately approved; component list	(see Annex 1)	N/A
	Part of the controlgear	(see Annex 3)	N/A
10 (9)	PROVISION FOR PROTECTIVE EARTHING		N/A
- (9.1)	Provisions for protective earthing		N/A
	Terminal complying with clause 9		N/A
	Locked against loosening and not possible to loosen by hand		N/A
	Not possible to loosen clamping means unintentionally on screwless terminals		N/A
	Earthing via means of fixing		N/A
	Earthing terminal only used for the earthing of the control gear		N/A
	All parts of material minimizing the danger of electrolytic corrosion		N/A
	Made of brass or equivalent material		N/A
	Contact surface bare metal		N/A
- (9.2)	Provision for functional earthing		N/A
	Comply with clause 8 and 9.1		N/A
- (9.3)	Earth contact via the track on the printed board		N/A
	Test with a current of 25 A between earthing terminal and each of the accessible metal parts; measured resistance (Ω) at ≥ 10 A according 7.2.3 of IEC 60598-1: $< 0,5 \Omega$		N/A



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.

Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China

Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com

Scan code to check authenticity



Attachment No.4

IEC/EN 61347-2-7			
Clause	Requirement + Test	Result - Remark	Verdict
- (9.4)	Earthing of built-in lamp controlgear		N/A
	Earth by means of fixing to earthed metal of luminaire in compliance of 7.2 of IEC 60598-1		N/A
	Earthing terminal only for earthing the built-in controlgear		N/A
- (9.5)	Earthing via independent controlgear		N/A
- (9.5.1)	Earth connection to other equipment		N/A
	Looping or through connection, conductor min. 1,5 mm ² and of copper or equivalent		N/A
	Protective earthing wires in line with 5.3.1.1 and clause 7		N/A
- (9.5.2)	Earthing of the lamp compartments powered via the independent lamp controlgear		N/A
	Test with a current of 25 A between input and output earth terminals; measured resistance (Ω) between earthing terminal and each of the accessible metal parts at ≥ 10 A according 7.2.3 of IEC 60598-1: $< 0,5 \Omega$	--	N/A
	Output earthing terminal marked as in 7.1 t) of IEC 61347-1		N/A
11 (11)	MOISTURE RESISTANCE AND INSULATION		P
	After storage 48 h at 91-95% relative humidity and 20-30 °C measuring of insulation resistance with d.c. 500 V (M Ω):		P
	For basic insulation ≥ 2 M Ω	$>100\text{M}\Omega$	P
	For double or reinforced insulation ≥ 4 M Ω	$>100\text{M}\Omega$	P
	Between primary and secondary circuits in controlgear providing SELV, values in Annex L in IEC 61347-1		P
12 (12)	ELECTRIC STRENGTH		P
	Immediately after clause 11 electric strength test for 1 min		P
	Basic insulation for SELV, test voltage 500 V		P





Attachment No.4

IEC/EN 61347-2-7			
Clause	Requirement + Test	Result - Remark	Verdict
	Working voltage ≤ 50 V, test voltage 500 V		N/A
	Working voltage > 50 V ≤ 1000 V, test voltage (V):		P
	Basic insulation, 2U + 1000 V	1480V	P
	Supplementary insulation, 2U + 1000 V		N/A
	Double or reinforced insulation, 4U + 2000 V	2960V	P
	No flashover or breakdown		P
	Solid or thin sheet insulation for double or reinforced insulation fulfil the requirements in Annex N in IEC 61347-1		N/A
15 (-)	STARTING CONDITIONS		P
	- after the switching test the ballast operate the lamps at rated operating voltage		P
	- the lamps start and operate from the appropriate mains operation reference ballast/circuit		P
16 (-)	LAMP CURRENT (only for fluorescent lamps)		N/A
	Lamp current not exceeding 125 % of that delivered to the same lamp when operated with a reference controlgear		N/A
17 (-)	SUPPLY CURRENT		P
	At the rated operating voltage, the supply current from the battery differ not more than ± 15 % from the marked value when operated with reference lamp		P
18 (-)	MAXIMUM CURRENT IN ANY LEAD (WITH CATHODE PREHEATING)		N/A
	If fluorescent lamp, the current flowing in any cathode termination not exceed the value given in lamp data sheet of IEC 60081 and IEC 60901	(see appended table)	N/A





Attachment No.4

IEC/EN 61347-2-7			
Clause	Requirement + Test	Result - Remark	Verdict
19 (-)	LAMP OPERATING CURRENT WAVEFORMS (only for fluorescent lamps)		N/A
	The peak current does not exceed 1,7 times the rated lamp current specified on lamp data sheets of IEC 60081 and IEC 60901	--	N/A
	The peak current does not exceed 3 times the measured r.m.s. lamp current	--	N/A
20 (-)	FUNCTIONAL SAFETY (EBLF, EOF_x)		P
20.1	Requirements for fluorescent lamp controlgear		N/A
	The controlgear provide the necessary light output after change over to the emergency mode		N/A
	- lowest value measured at 60 s and V ₁ or in steady conditions at V _{min} be retained and reach at least the declared EBLF	--	N/A
	- value measured at 5 s and V ₁ reach at reach least 50 % of declared EBLF	--	N/A
	- controlgear declared for high-risk task area lighting, lowest value measured at 0,5 s and V ₁ or in steady conditions at V _{min} be retained and reach at least the declared EBLF	--	N/A
20.2	Requirements for LED lamp controlgear		P
20.2.1	Constant current LED controlgear: EOF _I and I _{emergency}		P
	- lowest value measured at 60 s and V ₁ or V _{min} retained and reach at least the declared I _{emergency} and EOF _I	0.249A	P
	- value measured at 5 s and V ₁ reach at least 50 % of current I _{emergency}	0.249A	P
	- controlgear declared for high-risk task area lighting, lowest value measured at 0,5 s and V ₁ retained and reach at least the declared I _{emergency} and EOF _I		N/A



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.

Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China

Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com

Scan code to check authenticity



Attachment No.4

IEC/EN 61347-2-7			
Clause	Requirement + Test	Result - Remark	Verdict
21 (-)	CHANGE-OVER OPERATION		P
	Change over from normal to emergency mode at not less than 0,6 times and not greater than 0,85 times rated supply voltage		P
	Change over voltage (V)..... :	150.5V (From normal model to emergency mode)	P
	Supply reduced within 0,5 s to 0,6 times rated voltage, emergency lamps operated		P
	Switching of supply at 0,85 times rated voltage for 500 cycles 2 s "off" and 2 s "on". After these cycles, supply reduced to 0,6 times rated voltage. Emergency lamps operated during emergency mode and after the test.		P
	Controlgear with rest mode: automatic changeover from rest mode to normal mode at not greater than 0.9 times rated supply voltage		N/A
22 (-)	RECHARGING DEVICE		P
	Recharging device provide the rated charge performance specified by the battery manufacturer to charge the battery within 24 h		P
	Transformers in the recharging device comply with relevant parts of IEC 61558-2-1, IEC 61558-2-6 and IEC 61558-2-16		P
22.1 (-)	Low temperature operation		P
	Charged battery for 48 h and then discharged until voltage indicated in table 2 is achieved at 20 °C ± 5 °C		P
	Charged battery at 0,9 times rated supply voltage at minimum ambient temperature for 24 h		P
	Simulating supply failure, lamp operated for rated duration of operation and at the end the battery voltage is at least V_{min} according clause 20		P
22.2 (-)	High temperature operation		P



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.

Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China

Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com

Scan code to check authenticity



Attachment No.4

IEC/EN 61347-2-7			
Clause	Requirement + Test	Result - Remark	Verdict
	Charged battery for 48 h and then discharged until voltage indicated in table 2 is achieved at $20\text{ }^{\circ}\text{C} \pm 5\text{ }^{\circ}\text{C}$		P
	Charged at 0,9 times rated supply voltage at maximum ambient temperature for 24 h		P
	Simulating supply failure, lamp operated for rated duration of operation and at the end the battery voltage is at least V_{\min} according clause 20		P
22.3 (-)	Abnormal operating condition		P
	Recharging device operated at 1,1 times rated supply voltage and maximum marked ambient temperature with battery disconnected and output short-circuited		P
	- no flames, molten material or flammable gases		P
	After the test period and short-circuit removed		P
	- the recharging device is safe		P
	- normal recharge if self-resetting or user-replaceable protective devices		P
22.4 (-)	Maximum output voltage		P
	Output voltage of recharging device $\leq 50\text{ V r.m.s.}$ at 1,1 times rated supply voltage with or without batteries connected (V)..... :	Max. 6.72Vdc	P
22.5 (-)	Battery charge and discharge characteristics		P
	Charged battery for 48 h and then discharged until voltage indicated in table 2 is achieved at $20\text{ }^{\circ}\text{C} \pm 5\text{ }^{\circ}\text{C}$		P
	Charged at 0,9 and 1,1 times rated supply voltage at $25\text{ }^{\circ}\text{C} \pm 2\text{ }^{\circ}\text{C}$ for 24 h		P
	Current and voltage characteristics within those declared by controlgear manufacturer		P
22.6 (-)	Lamp failure		P
	Lamp failure do not interrupt charging current to battery and not impair the operation of the battery		P





Attachment No.4

IEC/EN 61347-2-7			
Clause	Requirement + Test	Result - Remark	Verdict
23 (-)	PROTECTION AGAINST EXCESSIVE DISCHARGE		P
	Protection against polarity reversal of individual cells, limits the discharge current when the battery voltage has fallen to V_{low} according a) to c)		P
	- Discharge current (A)	0.0001	P
	Protection system prevents any further discharge until the normal supply has been restored. Battery voltage not below V_{low} and discharge current not exceed a) to c)		P
	- Battery voltage (V)	6.55V	P
	- Discharge current (A)	0.249A	P
24 (-)	INDICATOR		P
	Compliance with 22.6.7 of IEC 60598-2-22		P
25 (-)	REMOTE CONTROL, REST MODE, INHIBITION MODE		N/A
25.1 (-)	No other changeover device than the switch between the battery and emergency lighting lamps		N/A
	Not contain manual or non-self-resetting switch isolating the emergency circuit from main supply		N/A
25.2 (-)	If rest mode facility, operation automatically revert to normal mode if restoration of normal supply		N/A
	If remote inhibiting facilities, provided with a means of connection to the remote inhibiting circuit		N/A
25.3 (-)	If for remote inhibiting facilities, in the emergency mode, not influenced by short circuit or contact to earth in the wiring to the remote control		N/A
	- Simulation of above faults in conjunction with tests of 28.2		N/A
25.4 (-)	Operation of remote control independent of the battery and mains supply		N/A
25.5 (-)	If rest mode facility in the emergency mode , not influenced by short circuit, contact to earth or interruption in the wiring to the remote control changeover device		N/A
	- Simulation of above faults in conjunction with tests of 28.2		N/A





Attachment No.4

IEC/EN 61347-2-7			
Clause	Requirement + Test	Result - Remark	Verdict
25.6 (-)	If rest mode or inhibiting facilities, in rest mode, current drain from batteries not exceed the values in 25.6		N/A
	- Discharge current (A) : --		N/A
26 (-)	TEMPERATURE CYCLING TEST AND ENDURANCE TEST		P
26.a (-)	Temperature cycling test: 5 cycles;		P
	- 1 h at minimum ambient temperature (°C) : 0		P
	- 1 h at maximum ambient temperature (°C) : 40		P
26.b (-)	Endurance test 50 h at an ambient that produces tc; ambient temperature (°C) :	40	P
	After test, controlgear restart and operate lamps at rated operating voltage		P
27 (-)	POLARITY REVERSAL		P
	If declared to be proof against polarity reversal, operating with reverse supply voltage for 1 h at maximum rated voltage		P
	After test, supply connected correctly, start and operate lamps normally		P
28 (14)	FAULT CONDITIONS		P
28.1 (14)	When operated under fault conditions the controlgear:		P
	- does not emit flames or molten material		P
	- does not produce flammable gases		P
	- protection against accidental contact not impaired		P
	Thermally protected controlgear does not exceed the marked temperature value		N/A
	Fault conditions: capacitors, resistors or inductors without proof of compliance with relevant specifications have been short-circuited or disconnected	(see appended table)	P



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.

Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China

Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com

Scan code to check authenticity



Attachment No.4

IEC/EN 61347-2-7			
Clause	Requirement + Test	Result - Remark	Verdict
- (14.1)	Short-circuit of creepage distances and clearances if less than specified in clause 16 in Part 1 (except between live parts and accessible metal parts)	(see appended table)	P
	Creepage distances on printed boards less than specified in clause 16 in Part 1 provided with coating according to IEC 60664-3		P
- (14.2)	Short-circuit or interruption of semiconductor devices	(see appended table)	P
- (14.3)	Short-circuit across insulation consisting of lacquer, enamel or textile	(see appended table)	N/A
- (14.4)	Short-circuit across electrolytic capacitors	(see appended table)	P
- (14.5)	After the tests has been carried out on three samples:		P
	The insulation resistance $\geq 1 \text{ M}\Omega$	>100M Ω	P
	No flammable gases		P
	No accessible parts have become live		P
	During the tests, a five-layer tissue paper, where the test specimen is wrapped, does not ignite		P
- (14.6)	Relevant fault condition tests with high-power supply		—
28.2 (-)	Short circuit, contact to earth or interruption in the wiring of the normal supply not influenced the emergency mode		P

29 (15)	CONSTRUCTION		P
- (15.1)	Wood, cotton, silk, paper and similar fibrous material		P
	Wood, cotton, silk, paper and similar fibrous material not used as insulation		P
- (15.2)	Printed circuits		P
	Printed circuits used as internal connections complies with clause 14		P
- (15.3)	Plugs and socket-outlets used in SELV or ELV circuits		N/A





Attachment No.4

IEC/EN 61347-2-7			
Clause	Requirement + Test	Result - Remark	Verdict
	No dangerous compatibility between output socket-outlet and a plug for socket-outlets for input circuit in relation to installation rules, voltages and frequencies		N/A
	Plugs and socket-outlets for SELV comply with IEC 60906-3 and IEC 60884-2-4		N/A
	Plugs and socket-outlets for SELV ≤ 3 A, ≤ 25 V r.m.s. or ≤ 60 V d.c. and ≤ 72 W comply with IEC 60906-3 and IEC 60884-2-4 or:		N/A
	- plugs not able to enter socket-outlets of other standardised system		N/A
	- socket-outlets not admit plugs of other standardised system		N/A
	- socket-outlets without protective earth		N/A
29.1.1 (-)	Compliance with 22.6.1, 22.6.7, 22.6.9, 22.6.11, 22.6.19 and 22.20 of IEC 60598-2-22 if applicable		P
29.1.2 (-)	Battery comply with Annex I		P
	Battery designed for at least 4 years of operation		P
	Battery only use for emergency functions		P
30 (16)	CREEPAGE DISTANCES AND CLEARANCES		P
- (16.1)	General		P
- (16)	Creepage distances and clearances according to 16.2 and 16.3		P
	Controlgears providing SELV comply with additional requirements in Annex L	(see Annex L)	P
	Insulating lining of metallic enclosures		N/A
	Controlgear protected against pollution comply with Annex P	(see Annex P)	N/A
- (16.2)	Creepage distances		P
- (16.2.2)	Minimum creepage distances for working voltages		P
	Creepage distances according to Table 7	(see appended table)	P
- (16.2.3)	Creepage distances for working voltages with frequencies above 30 kHz		N/A
	Creepage distances according to Table 8	(see appended table)	N/A





Attachment No.4

IEC/EN 61347-2-7			
Clause	Requirement + Test		Verdict
- (16.3)	Clearances		P
- (16.3.2)	Clearances for working voltages		P
	Clearances distances according to Table 9	(see appended table)	P
- (16.3.3)	Clearances for ignition voltages and working voltages with higher frequencies		N/A
	Clearances distances for basic or supplementary insulation according to Table 10	(see appended table)	N/A
	Clearances distances for reinforced insulation according to Table 11	(see appended table)	N/A
31 (17)	SCREWS, CURRENT-CARRYING PARTS AND CONNECTIONS		P
	Screws, current-carrying parts and connections in compliance with IEC 60598-1 (clause numbers between parentheses refer to IEC 60598-1)		P
(4.11)	Electrical connections		P
(4.11.1)	Contact pressure		P
(4.11.2)	Screws:		N/A
	- self-tapping screws		N/A
	- thread-cutting screws		N/A
(4.11.3)	Screw locking:		N/A
	- spring washer		N/A
	- rivets		N/A
(4.11.4)	Material of current-carrying parts		P
(4.11.5)	No contact to wood or mounting surface		P
(4.11.6)	Electro-mechanical contact systems		N/A
(4.12)	Mechanical connections and glands		N/A
(4.12.1)	Screws not made of soft metal		N/A
	Screws of insulating material		N/A
	Torque test: torque (Nm); part.....:		N/A
	Torque test: torque (Nm); part.....: --		N/A
	Torque test: torque (Nm); part.....: --		N/A
(4.12.2)	Screws with diameter < 3 mm screwed into metal		N/A
(4.12.4)	Locked connections:		N/A
	- fixed arms; torque (Nm).....: --		N/A
	- lampholder; torque (Nm).....: --		N/A





Attachment No.4

IEC/EN 61347-2-7			
Clause	Requirement + Test	Result - Remark	Verdict
	- push-button switches; torque 0,8 Nm..... :	--	N/A
(4.12.5)	Screwed glands; force (Nm)..... :	--	N/A
32 (18)	RESISTANCE TO HEAT, FIRE AND TRACKING		P
- (18.1)	Ball-pressure test	See IEC60598-2-22 part	P
- (18.2)	Test of printed boards	See IEC60598-2-22 part	P
- (18.3)	Glow-wire test	See IEC60598-2-22 part	P
- (18.4)	Needle flame test	See IEC60598-2-22 part	P
- (18.5)	Tracking test	See Test Table 22.16	N/A
33 (19)	RESISTANCE TO CORROSION		N/A
	- test according 4.18.1 of IEC 60598-1		N/A
	- adequate varnish on the outer surface		N/A
34	Abnormal lamp conditions		P
34.1	Controlgear not impair safety operated under abnormal conditions		P
34.2	Abnormal conditions for controlgear for fluorescent lamps		N/A
	a) lamp not inserted		N/A
	b) lamp does not start because cathode is broken		N/A
	c) de-active lamp		N/A
	d) lamp operates with rectifying effect		N/A
34.3	Abnormal conditions for d.c. supplied electronic step-down convertors for filament lamps		N/A
	Output voltage of the convertor not exceed 115% of rated output voltage under abnormal conditions		N/A
	a) lamp not inserted		N/A
	b) twice the number of lamps		N/A
	c) output terminals short-circuited		N/A
34.4	Abnormal conditions for controlgear for d.c. supplied electronic controlgear for LED modules		P
34.4.1	Length of output cable 20 cm and 200 cm in 34.4.2 or 34.4.3		P



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.

Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China

Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com

Scan code to check authenticity



Attachment No.4

IEC/EN 61347-2-7			
Clause	Requirement + Test		Verdict
34.4.2	Controlgear of constant voltage type		N/A
	a) no LED module inserted		N/A
	b) double LED modules in parallel		N/A
	c) output terminals short-circuited		N/A
34.4.3	Controlgear of constant current type		P
	a) no LED module inserted (and all at same time)		P
	b) double LED modules in series		P
	c) output terminals short-circuited		P
34.5	Abnormal conditions for ballast for d.c. supplied electronic controlgear for discharge lamps		N/A
	a) lamp not inserted or does not ignite		N/A
	b) burner leaks		N/A
	c) lamp operates, but rectifies		N/A
34.6	Compliance		P
	- does not emit flames or molten material		P
	- does not produce flammable gases		P
	- protection against accidental contact according 10.1 of IEC 61347-1 not impaired		P
	- insulation resistance $\geq 1 \text{ M}\Omega$	>100M Ω	P
35	Protection of associated components		N/A
35.1	Controlgear for fluorescent lamps		N/A
35.1.1	Peak voltage limits		N/A
	Voltage at output terminals not exceed maximum permitted peak value in Table 2 (V)	--	N/A
35.1.2	Working voltage limits		N/A
	Voltage at output terminals not exceed declared maximum working voltage under normal operating, and from 5 s after start (V)	--	N/A
35.1.3	Compliance		N/A
	Voltage in 35.1 and 35.2 in compliance with the limits, measured between output terminal and earth		N/A



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.

Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China

Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com

Scan code to check authenticity



Attachment No.4

IEC/EN 61347-2-7			
Clause	Requirement + Test	Result - Remark	Verdict
	Voltage in 35.1 and 35.2 in compliance with the limits, measured between output terminals if the voltage present across insulation barriers within associated components		N/A

28 (14)	TABLE: tests of fault conditions		P
Part	Simulated fault	Test result	Hazard
C1	s-c	Fuse open, no flame, no flammable gas, no molten parts	No
C3	s-c	Fuse open, no flame, no flammable gas, no molten parts	No
U1	s-c	Fuse open, no flame, no flammable gas, no molten parts	No
T1	s-c	Fuse open, no flame, no flammable gas, no molten parts	No
C6	s-c	Shut down, recoverable, no flame, no flammable gas, no molten parts	No
IC3	s-c	Shut down, recoverable, no flame, no flammable gas, no molten parts	No
Output (+&-)	s-c	Shut down, recoverable, no flame, no flammable gas, no molten parts	No



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.
Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China
Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com
Scan code to check authenticity



Attachment No.4

IEC/EN 61347-2-7			
Clause	Requirement + Test	Result - Remark	Verdict
A	ANNEX A IN PART 1: TEST TO ESTABLISH WHETHER A CONDUCTIVE PART IS A LIVE PART WHICH MAY CAUSE AN ELECTRIC SHOCK		N/A
A.1	Comply with A.2 or A.3	Rely up on luminaries enclosure	N/A
A.2	Voltage ≤ 35 V peak or ≤ 60 V d.c	--	N/A
A.3	If voltage > 35 V peak or > 60 V d.c. or protective impedance device; touch current does not exceed 0,7 mA (peak) or 2 mA d.c.	--	N/A
	Comply with Annex G of IEC 60598-1		N/A
C	ANNEX C IN PART 1: PARTICULAR REQUIREMENTS FOR ELECTRONIC LAMP CONTROLGEAR WITH MEANS OF PROTECTION AGAINST OVERHEATING		N/A
C3	GENERAL REQUIREMENTS		N/A
C3.1	Thermal protection means integral with the controlgear, protected against mechanical damage		N/A
	Renewable only by means of a tool		N/A
	If function depending on polarity, for cord-connected equipment protection means in both leads		N/A
	Thermal links comply with IEC 60691		N/A
	Electrical controls comply with IEC 60730-2-3		N/A
C3.2	No risk of fire by breaking (clause C7)		N/A
C5	CLASSIFICATION		N/A
	a) automatic resetting type		—
	b) manual resetting type		—
	c) non-renewable, non-resetting type		—
	d) renewable, non-resetting type		—



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.

Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China

Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com

Scan code to check authenticity



Attachment No.4

IEC/EN 61347-2-7			
Clause	Requirement + Test	Result - Remark	Verdict
	e) other type of thermal protection; description ...:		—
C6	MARKING		N/A
C6.1	Symbol for temperature declared thermally protected controlgear		N/A
C6.2	Declaration of the type of protection provided		N/A
C7	LIMITATION OF HEATING		N/A
C7.1	Preselection test:		N/A
	Test sample placed for at least 12 h in an oven having temperature ($t_c - 5$) K		N/A
	No operation of the protection device		N/A
C7.2	Functioning of protection means:		N/A
	Normal operation of the sample in a test enclosure according to Annex D at an ambient temperature such that ($t_c + 0$; -5) °C is obtained		N/A
	No operation of the protection device		N/A
	Introducing of the most onerous test condition determined during test of clause 14		N/A
	Output of windings connected to the mains supply short-circuited, and other part of the controlgear operated under normal conditions		N/A
	Increasing of the current through the windings continuously until operation of the protection means		N/A
	Continuous measuring of the highest surface temperature		N/A
	Controlgear according to C5 a) or C5 e) operated until stable conditions are achieved		N/A
	Automatic-resetting thermal protectors working 3 times		N/A





Attachment No.4

IEC/EN 61347-2-7			
Clause	Requirement + Test	Result - Remark	Verdict
	Controlgear according to C5 b) working 6 times		N/A
	Controlgear according to C5 c) and C5) d) working once		N/A
	Highest temperature does not exceed the marked value		N/A
	Any overshoot of 10% over the marked value within 15 min		N/A
D	ANNEX D IN PART 1: REQUIREMENTS FOR CARRY OUT THE HEATING TESTS OF THERMALLY PROTECTED LAMP CONTROLGEAR		N/A
	Tests in C7 performed in accordance with Annex D, if applicable		N/A
F	ANNEX F IN PART 1: DRAUGHT-PROOF ENCLOSURE		P
	Draught-proof enclosure in accordance with the description		P
	Dimensions of the enclosure		P
	Other design; description		N/A
H	ANNEX H IN PART 1: TESTS		P
	All tests performed in accordance with the advice given in Annex H, if applicable		P
I (-)	ANNEX I IN THIS PART 2: BATTERIES FOR EMERGENCY LUMINAIRES (Annex numbers between parentheses refer to IEC 60598-2-22)		P
(A.1)	Type of batteries	Li-ion	P
(A.2)	Conform to relevant standard	IEC 62133	P
	Operate within specific tolerance		P
(A.3)	Battery capacity for rated duration up to time of replacement		P
(A.4)	Sealed nickel cadmium batteries		N/A





Attachment No.4

IEC/EN 61347-2-7			
Clause	Requirement + Test	Result - Remark	Verdict
(A.4.1)	Conform to IEC 60285		N/A
(A.4.2.a)	Maximum ambient air temperature 50 °C		N/A
(A.4.2.b)	Maximum overcharge rate 0,08 C _{5A}		N/A
(A.4.2.c)	Minimum ambient temperature 5 °C		N/A
(A.4.2.d)	Maximum discharge rates for 1 h: 0,6 C _{5A} and 3 h: 0,25 C _{5A}		N/A
(A.5)	Valve regulated lead acid batteries		N/A
(A.5.1)	Conform to IEC 60869-2 or IEC 61056-1		N/A
(A.5.2.a)	Maximum ambient air temperature 30 °C with temperature compensation or 25 °C without temperature compensation		N/A
(A.5.2.b)	Minimum recharge current 0,4 C ₂₀		N/A
(A.5.2.c)	Maximum discharge rates for 1 h: 0,4 C ₂₀ and 3 h: 0,17 C ₂₀		N/A
(A.5.2.d)	Maximum r.m.s. ripple current 0,1 C ₂₀		N/A
(A.5.2.e)	Minimum ambient temperature 5 °C		N/A
(A.6)	Ambient temperature of cells measured after 48 h		P
(A.7)	Evidence of alternative operating parameters		N/A
J	ANNEX J: REST MODE AND INHIBITION MODE FACILITIES (ANNEX D IN IEC 60598-2-22)		N/A
	Rest mode:		N/A
	a) only operate when normal supply has failed		N/A
	b) remote control wiring is fail-safe		N/A
	c) normal mode at restoration of normal supply		N/A
	Inhibition mode:		N/A
	a) supply failure or disconnection not cause an unwanted discharge		N/A
	b) protection against interruption of remote control wiring		N/A
	1) safety circuits independent of other circuits		N/A
	2) safety circuits not pass through locations exposed to fire risk or explosion risk		N/A
	3) protection against overload may be omitted		



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.

Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China

Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com

Scan code to check authenticity



Attachment No.4

IEC/EN 61347-2-7			
Clause	Requirement + Test	Result - Remark	Verdict
	4) overcurrent in one circuit not impair circuits of safety services		N/A
	5) switchgear and controlgear clearly identified and in locations accessible only to competent persons		N/A
	6) Alarm devices clearly identified		N/A
K	ANNEX K IN PART 1: BALLASTS INCORPORATING AN AUTOMATIC TESTING FUNCTION FOR EMERGENCY LIGHTING OPERATION		P
	Fulfil relevant requirements of Table K.1	For automatic test function.	P
- (L)	ANNEX L IN PART 1: PARTICULAR ADDITIONAL REQUIREMENTS FOR CONTROLGEARS PROVIDING SELV		P
- (L.3)	Classification		N/A
	Class I	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	—
	Class II	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	—
	Class III	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	—
	non-inherently short circuit proof controlgear	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>	—
	inherently short circuit proof controlgear	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	—
	fail safe controlgear	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	—
	non-short-circuit proof controlgear	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	—
- (L.4)	Marking		N/A
	Adequate symbols are used		N/A
- (L.5)	Protection against electric shock		P
	Comply with clause 9.2 of IEC 61558-1		P
- (L.6)	Heating		P
	No excessive temperatures in normal use		P
	Value if capacitor t_c marked	See ANNEX 1	—
	Winding insulation classified as Class	Class B	—





Attachment No.4

IEC/EN 61347-2-7			
Clause	Requirement + Test	Result - Remark	Verdict
	Comply with tests of clause 14 of IEC 61558-1 with adjustments		N/A
- (L.7)	Short-circuit and overload protection		P
	Comply with tests of clause 15 of IEC 61558-1 with adjustments		P
- (L.8)	Insulation resistance and electric strength		P
- (L.8.1)	Conditioned 48 h between 91 % and 95 %		P
- (L.8.2)	Insulation resistance		P
	Between input- and output circuits not less than 5 MΩ	>100 MΩ	P
	Between metal parts of class II convertors which are separated from live parts by basic insulation only and the body not less than 5 MΩ	--	N/A
	Between metal foil in contact with the inner and outer surfaces of enclosures of insulating material not less than 2 MΩ	--	N/A
- (L.8.3)	Electric strength		P
	1) Between live parts of input circuits and live parts of output circuits	3750V	P
	2) Over basic or supplementary insulation between:		P
	a) live parts having different polarity	1875V	P
	b) live parts and body if intended to be connected to protective earth	--	N/A
	c) accessible metal parts and a metal rod of the same diameter as the flexible cable or cord	--	N/A
	d) live parts and an intermediate metal part	--	N/A
	e) intermediate metal parts and the body	--	N/A
	f) each input circuit and all other input circuits	--	N/A



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.

Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China

Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com

Scan code to check authenticity



Attachment No.4

IEC/EN 61347-2-7			
Clause	Requirement + Test	Result - Remark	Verdict
	3) Over reinforced insulation between the body and live parts		N/A
- (L.9)	Construction		P
- (L.9.1)	Transformer comply with 19.12 of IEC 61558-1 and 19 of IEC 61558-2-6		P
	HF transformer comply with 19 of IEC 61558-2-16		P
- (L.10)	Components		P
	Protective devices comply with 20.6 – 20.11 of IEC 61558-1		P
- (L.11)	Creepage distances, clearances and distances through insulation		P
	Creepage distances and clearances not less than in Clause 16		P
	Distance through insulation according Table L.5 in IEC 61347-1		N/A
	1) Basic distance through insulation		N/A
	Required distance (mm)	--	—
	Measured (mm)	--	N/A
	Supplementary information		—
	2) Supplementary distance through insulation		N/A
	Required distance (mm)	--	—
	Measured (mm)	--	N/A
	Supplementary information		—
	3) Reinforced distance through insulation		N/A
	Required distance (mm)	--	—
	Measured (mm)	--	N/A
	Supplementary information		—



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.

Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China

Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com

Scan code to check authenticity



Attachment No.4

IEC/EN 61347-2-7			
Clause	Requirement + Test	Result - Remark	Verdict
- (N)	ANNEX N IN PART 1: REQUIREMENTS FOR INSULATION MATERIALS USED FOR DOUBLE OR REINFORCED INSULATION		N/A
- (N.4)	General requirements		N/A
- (N.4.1)	Material comply with IEC 60085 and IEC 60216 series		N/A
- (N.4.2)	Solid insulation		N/A
	Electric strength test at least 5 kV or 1,35 x test voltage in Table N.1		N/A
	If not classified according IEC 60085 and IEC 60216 series: Electric strength test increased 10 % to 5,5 kV or 1,5 x test voltage in Table N.1		N/A
- (N.4.3)	Thin sheet insulation		N/A
- (N.4.3.1)	Thickness and composition of thin sheet insulation		N/A
	- Inside the ballast and not subjected to handling or abrasion during the production and during maintenance		N/A
	- Non-separated layers: Min. 3 layers and fulfil mandrel test of 150N		N/A
	- Separated layers: Min. 2 layers and each layer fulfil mandrel test of 50N		N/A
	- Separated layers (alternative): Min. 3 layers and 2/3 of the layers fulfil mandrel test of 100N		N/A
- (N.4.3.2)	Mandrel test (electric strength test during mechanical stress)		N/A
	Electric strength test after mandrel test:		N/A
	- Non-separated layers: min. 5 kV or 1,35 x test voltage in Table N.1		N/A
	- 2/3 of min. 3 separated layers: min. 5 kV or 1,25 x test voltage in Table N.1		N/A
	- one of 2 separated layers: min. 5 kV or 1,25 x test voltage in Table N.1		N/A



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.

Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China

Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com

Scan code to check authenticity



Attachment No.4

IEC/EN 61347-2-7			
Clause	Requirement + Test	Result - Remark	Verdict
	No flashover or breakdown occurred		N/A
- (O)	ANNEX O IN PART 1: ADDITIONAL REQUIREMENTS FOR BUILT-IN ELECTRONIC CONTROLGEAR WITH DOUBLE OR REINFORCED INSULATION		N/A
- (O.6)	Marking		N/A
	Marking according clause 7 (7)	See clause 7	N/A
	Special symbol		N/A
	Meaning of the special symbol explained in catalogue		N/A
- (O.7)	Protection against accidental contact with live parts		N/A
	Requirements of clause 8 (10)	See clause 8	N/A
	Test finger not possible to make contact with basic insulated metal parts		N/A
- (O.8)	Terminals		N/A
	Clause 9 (8)	See clause 9	N/A
- (O.9)	Provision for earthing		N/A
	Functional earthing terminals comply with clause 9 of part 1		N/A
	No protective earthing terminal		N/A
- (O.10)	Moisture resistance and insulation		N/A
	Clause 11 (11)	See clause 11	N/A
- (O.11)	Electric strength		N/A
	Clause 12 (12)	See clause 12	N/A
- (O.13)	Fault conditions		N/A
	Clause - (14)	See clause 28	N/A
	End of test, between live part and accessible metal parts or external parts of insulating material in contact with the supporting surface comply with dielectric strength test according clause 12 reduced to 35 % of values according Table 1 in part 1		N/A
	Insulation resistance according to O.10 between live part and accessible metal parts or external parts of insulating material in contact with the supporting surface not less than 4 MΩ		N/A
- (O.14)	Construction		N/A
	Clause 29 (15)	See clause 29	N/A



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.

Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China

Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com

Scan code to check authenticity



Attachment No.4

IEC/EN 61347-2-7			
Clause	Requirement + Test	Result - Remark	Verdict
	Accessible metal parts insulated from live parts by double or reinforced insulation		N/A
	Live part insulated from supporting surface in contact with external faces by double or reinforced insulation		N/A
- (O.15)	Creepage distances and clearances		N/A
	Clause 30 (16)	See clause 30	N/A
	Comply with corresponding values for luminaries in IEC 60598-1		N/A
- (O.16)	Screws, current-carrying parts and connections		N/A
	Clause 31 (17)	See clause 31	N/A
- (O.17)	Resistance to heat and fire		N/A
	Clause 32 (18)	See clause 32	N/A
- (O.18)	Resistance to corrosion		N/A
	Clause 33 (19)	See clause 33	N/A



**Attachment No.5**

IEC 61347-2-13			
Clause	Requirement + Test	Result - Remark	Verdict

4 (4)	GENERAL REQUIREMENTS		P
- (4)	Insulation materials according requirements in Annex N of IEC 61347-1	(see Annex N)	N/A
- (4)	Compliance of independent controlgear enclosure with IEC 60598- 1		N/A
	IP classification		N/A
	Mechanical stress		N/A
- (4)	Built-in magnetic ballast with double or reinforced insulation comply with Annex I of IEC 61347-1		N/A
- (4)	Built-in electronic controlgear with double or reinforced insulation comply with Annex O of IEC 61347-1	(see Annex O)	N/A
	Integral lamp controlgear compliance with clause 0.5 of EN 60598-1		P
4 (4)	SELV controlgear comply with Annex I of this part 2 and Annex L of IEC 61347-1		P
4 (-)	Transformer comply with IEC 61558		P
	Dielectric strength test of insulated winding wires is limited to 3 kV if input voltage \leq 300 V		P

6 (6)	CLASSIFICATION		P
	Built-in controlgear	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	—
	Independent controlgear.....	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	—
	Integral controlgear	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>	—
6 (-)	Auto-wound controlgear	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	—
	Separating controlgear	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	—
	Isolating controlgear	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>	—
	SELV controlgear	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>	—

7 (7)	MARKING		N/A
7.1 (7.1)	Mandatory markings		N/A
	a) mark of origin		N/A
	b) model number or type reference		N/A



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.

Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China

Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com

Scan code to check authenticity

**Attachment No.5**

IEC 61347-2-13			
Clause	Requirement + Test	Result - Remark	Verdict
	c) symbol for independent controlgear, if applicable		N/A
	d) correlation between interchangeable parts and controlgear marked		N/A
	e) rated supply voltage (V)		N/A
	supply frequency (Hz)		N/A
	supply current (A)		N/A
	f) earthing symbol		N/A
	g) rated maximum operating temperature of the winding		N/A
	h) indication that the lamp controlgear		N/A
	indication of the cross-section of conductors for which the terminals.		N/A
	j) the lamp type and rated wattage or wattage range for which the lamp controlgear is suitable, or the designation as indicated on the lamp data sheet of the type(s) of lamp(s) for which the lamp controlgear is designed		N/A
	k) wiring diagram		N/A
	l) value of t_c		N/A
	m) symbol for declared temperature		N/A
	n) heat sink(s)		N/A
	o) the limiting temperature		N/A
	p) the test period for the endurance test		N/A
	q) for lamp controlgear for which a constant S		N/A
	r) the rated no-load output voltage, when it is higher than the supply voltage		N/A
	s) symbol indicating the kind of controlgear providing SELV		N/A
	t) LUM earthing symbol		N/A
	u) if not SELV maximum working voltage U_{out} between:		N/A
	- output terminals (V)	--	N/A
	- output terminals and earth (V)	--	N/A



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.

Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China

Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com

Scan code to check authenticity

**Attachment No.5**

IEC 61347-2-13			
Clause	Requirement + Test	Result - Remark	Verdict
	v) Declaration of the maximum equivalent output peak voltage U_p		N/A
	w) maximum output peak voltage \hat{U}_{out} and its corresponding frequency f_{Uout}		N/A
7.1 (-)	Constant voltage type:	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	—
	- rated output power P_{rated} (W)	--	N/A
	- rated output voltage U_{rated} (V)	--	N/A
	Constant current type:	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>	—
	- rated output power P_{rated} (W)		N/A
	- rated output current I_{rated} (A)		N/A
	Indication if for LED modules only		N/A
7.1 (7.2)	Marking durable and legible		N/A
	Rubbing 15 s water, 15 s petroleum; marking legible		N/A
7.2 (7.1)	Information to be provided, if applicable		N/A
	h) declaration on protection against accidental contact		N/A
	i) cross-section of conductors (mm ²)		N/A
	j) number, type and wattage of lamp(s)		N/A
	s) SELV symbol		N/A
7.2 (-)	- declaration of mains connected windings		N/A

8 (10)	PROTECTION AGAINST ACCIDENTAL CONTACT WITH LIVE PARTS		—
- (10.1)	Controlgear protected against accidental contact with live parts	Rely on luminaires enclosure	P
- (A2)	Voltage measured with 50 k Ω	(see Annex A)	N/A
- (A3)	Voltage > 35 V peak or > 60 V d.c. or protective impedance device	(see Annex A)	N/A
- (10.1)	Lacquer or enamel not used for protection or insulation		P
	Adequate mechanical strength on parts providing protection		N/A
- (10.2)	Capacitors > 0,5 μ F: voltage after 1 min (V): < 50 V	4V after 1min.	P



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.

Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China

Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com

Scan code to check authenticity

**Attachment No.5**

IEC 61347-2-13			
Clause	Requirement + Test	Result - Remark	Verdict
- (10.3)	Controlgear providing SELV		P
	Accessible conductive parts are insulated from live parts by double or reinforced insulation in SELV controlgear		P
	No connection between output circuit and the body or protective earthing circuit		P
	No possibility of connection between output circuit and the body or protective earthing circuit through other conductive parts		N/A
	SELV outputs separated by at least basic insulation		P
	ELV conductive parts insulated as live parts		N/A
	Tests according Annex L of IEC 61347-1		P
- (10.4)	Accessible conductive parts in SELV circuits		P
	Output voltage under load ≤ 25 V r.m.s. or ≤ 60 V d.c.		P
	If output voltage > 25 V r.m.s. or > 60 V d.c.; No load output ≤ 35 V peak or ≤ 60 V d.c. and touch current does not exceed 0,7 mA (peak) or 2 mA d.c. :	--	N/A
	One conductive part is insulated if output voltage or current exceeding the values above and withstand test voltage 500 V		N/A
	Double or reinforced insulation bridged by appropriate and at least two resistors or two Y2 capacitors or one Y1 capacitor	Y1 capacitor	P
	Y1 or Y2 capacitors comply with IEC 60384-14		P
	Resistors comply with test (a) in 14.1 of IEC 60065		N/A

9 (8)	TERMINALS		—
	Screw terminals according section 14 of IEC 60598-1:		N/A
	Separately approved; component list	(see Annex 1)	N/A
	Part of the controlgear	(see Annex 3)	N/A



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.

Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China

Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com

Scan code to check authenticity

**Attachment No.5****IEC 61347-2-13**

Clause	Requirement + Test	Result - Remark	Verdict
--------	--------------------	-----------------	---------

	Screwless terminals according section 15 of IEC 60598-1:		N/A
	Separately approved; component list	(see Annex 1)	N/A
	Part of the controlgear	(see Annex 4)	N/A

10 (9)	PROVISION FOR PROTECTIVE EARTHING		—
- (9.1)	Provisions for protective earthing		N/A
	Terminal complying with clause 8		N/A
	Locked against loosening and not possible to loosen by hand		N/A
	Not possible to loosen clamping means unintentionally on screwless terminals		N/A
	Earthing via means of fixing		N/A
	Earthing terminal only used for the earthing of the control gear		N/A
	All parts of material minimizing the danger of electrolytic corrosion		N/A
	Made of brass or equivalent material		N/A
	Contact surface bare metal		N/A
- (9.2)	Provision for functional earthing		N/A
	Comply with clause 8 and 9.1		N/A
- (9.3)	Earth contact via the track on the printed board		N/A
	Test with a current of 25 A between earthing terminal and each of the accessible metal parts; measured resistance (Ω) at ≥ 10 A according 7.2.3 of IEC 60598-1: $< 0,5 \Omega$		N/A
- (9.4)	Earthing of built-in lamp controlgear		N/A
	Earth by means of fixing to earthed metal of luminaire in compliance of 7.2 of IEC 60598-1		N/A
	Earthing terminal only for earthing the built-in controlgear		N/A
- (9.5)	Earthing via independent controlgear		N/A
- (9.5.1)	Earth connection to other equipment		N/A
	Looping or through connection, conductor min. $1,5 \text{ mm}^2$ and of copper or equivalent		N/A



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.

Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China

Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com

Scan code to check authenticity

**Attachment No.5**

IEC 61347-2-13			
Clause	Requirement + Test	Result - Remark	Verdict
	Protective earthing wires in line with 5.3.1.1 and clause 7		N/A
- (9.5.2)	Earthing of the lamp compartments powered via the independent lamp controlgear		N/A
	Test with a current of 25 A between input and output earth terminals; measured resistance (Ω) between earthing terminal and each of the accessible metal parts at ≥ 10 A according 7.2.3 of IEC 60598-1: $< 0,5 \Omega$	--	N/A
	Output earthing terminal marked as in 7.1 t) of IEC 61347-1		N/A

11 (11)	MOISTURE RESISTANCE AND INSULATION		P
	After storage 48 h at 91-95% relative humidity and 20-30 °C measuring of insulation resistance with d.c. 500 V ($M\Omega$):		P
	For basic insulation $\geq 2 M\Omega$	$> 100 M\Omega$	P
	For double or reinforced insulation $\geq 4 M\Omega$	$> 100 M\Omega$	P
	Between primary and secondary circuits in controlgear providing SELV, values in Annex L in IEC 61347-1		P

12 (12)	ELECTRIC STRENGTH		P
	Immediately after clause 11 electric strength test for 1 min		P
	Basic insulation for SELV, test voltage 500 V		P
	Working voltage ≤ 50 V, test voltage 500 V		N/A
	Working voltage > 50 V ≤ 1000 V, test voltage (V):		P
	Basic insulation, $2U + 1000$ V	1480V	P
	Supplementary insulation, $2U + 1000$ V		N/A
	Double or reinforced insulation, $4U + 2000$ V	2960V	P
	No flashover or breakdown		P
	Solid or thin sheet insulation for double or reinforced insulation fulfil the requirements in Annex N in IEC 61347-1		N/A



**Attachment No.5**

IEC 61347-2-13			
Clause	Requirement + Test	Result - Remark	Verdict

13(13)	THERMAL ENDURANCE TEST FOR WINDINGS OF BALLAST		—
--------	-------------------------------------------------------	--	---

14 (14)	FAULT CONDITIONS		P
- (14.1)	When operated under fault conditions the controlgear:		P
	- does not emit flames or molten material		P
	- does not produce flammable gases		P
	- protection against accidental contact not impaired		P
	Thermally protected controlgear does not exceed the marked temperature value		N/A
	Fault conditions: capacitors, resistors or inductors without proof of compliance with relevant specifications have been short-circuited or disconnected	(see appended table)	P
- (14.2)	Short-circuit of creepage distances and clearances if less than specified in clause 16 in Part 1 (except between live parts and accessible metal parts)	(see appended table)	P
	Creepage distances on printed boards less than specified in clause 16 in Part 1 provided with coating according to IEC 60664- 3		N/A
- (14.3)	Short-circuit or interruption of semiconductor devices	(see appended table)	P
- (14.4)	Short-circuit across insulation consisting of lacquer, enamel or textile	(see appended table)	N/A
- (14.5)	Short-circuit across electrolytic capacitors	(see appended table)	P
- (14.6)	After the tests has been carried out on three samples:		P
	The insulation resistance $\geq 1 \text{ M}\Omega$: > 100 M Ω		P
	No flammable gases		P
	No accessible parts have become live		P
	During the tests, a five-layer tissue paper, where the test specimen is wrapped, does not ignite		P
	Accessible parts compliance with Annex A		N/A



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.

Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China

Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com

Scan code to check authenticity

**Attachment No.5**

IEC 61347-2-13			
Clause	Requirement + Test	Result - Remark	Verdict
- (14.7)	Relevant fault condition tests with high-power supply		—
14 (-)	Temperature declared thermally protected lamp controlgear fulfil requirements in Annex C		N/A

15 (-)	TRANSFORMER HEATING		—
15.1(-)	General		P
	Transformer comply with clause L.6 and L.7 of IEC 61347-1		P
	Output voltage of SELV controlgear not exceed limits in 10.4 of IEC 61347-1 during the test of 15.1 and 15.2		P
15.2 (-)	Normal operation		P
	Comply with clause L.6 of IEC 61347-1		P
15.3 (-)	Abnormal operation		P
	Comply with clause L.7 of IEC 61347-1		P
	Double LED modules or equivalent load connected in parallel to the output terminals of constant voltage type		N/A
	Double LED modules or equivalent load connected in series to the output terminals of constant current type		P
15.3 (-)	During and at the end of the tests no defect impairing safety, nor any smoke or flammable gases produced		P

16 (15)	CONSTRUCTION		P
- (15.1)	Wood, cotton, silk, paper and similar fibrous material		P
	Wood, cotton, silk, paper and similar fibrous material not used as insulation		P
- (15.2)	Printed circuits		P
	Printed circuits used as internal connections complies with clause 14		P



**Attachment No.5**

IEC 61347-2-13			
Clause	Requirement + Test	Result - Remark	Verdict
- (15.3)	Plugs and socket-outlets used in SELV or ELV circuits		N/A
	No dangerous compatibility between output socket-outlet and a plug for socket-outlets for input circuit in relation to installation rules, voltages and frequencies		N/A
	Plugs and socket-outlets for SELV comply with IEC 60906-3 and IEC 60884-2-4		N/A
	Plugs and socket-outlets for SELV $\leq 3\text{ A}$, $\leq 25\text{ V}$ r.m.s. or $\leq 60\text{ V d.c.}$ and $\leq 72\text{ W}$ comply with IEC 60906-3 and IEC 60884-2-4 or:		N/A
	- plugs not able to enter socket-outlets of other standardised system		N/A
	- socket-outlets not admit plugs of other standardised system		N/A
	- socket-outlets without protective earth		N/A
- (15.4)	Insulation between circuits and accessible parts		P
- (15.4.1)	Controlgear shall provide suitable insulation between different electrical circuits and to accessible parts.		N/A
- (15.4.2)	SELV circuits		P
	Used SELV source		P
	Voltage \leq ELV		P
	insulated from the LV supply by double or reinforced insulation		P
	insulated from other non SELV circuits (except FELV) by double or reinforced insulation		N/A
	insulated from FELV circuits by supplementary insulation		N/A
	insulated from other SELV circuits by basic insulation		N/A
	SELV circuits shall be insulated from accessible conductive parts by insulation according to Table 6 in 15.4.5.		N/A
-(15.4.3)	FELV circuits		N/A
	Sources used FELV circuits		N/A



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.

Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China

Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com

Scan code to check authenticity

**Attachment No.5**

IEC 61347-2-13			
Clause	Requirement + Test	Result - Remark	Verdict
	Voltage \leq ELV		N/A
	insulated from the LV supply by at least basic insulation		N/A
	not required that FELV circuits shall be insulated from other FELV circuits except for functional purpose.		N/A
	insulated from accessible conductive parts by an insulation according to Table 6 in 15.4.5.		N/A
	required in Clause 10, 11, 12 and 16 of this standard.		N/A
	plugs shall not be able to enter socket-outlets of other voltage systems;		N/A
	socket-outlets shall not admit plugs of other voltage systems;		N/A
	socket-outlets shall have a protective conductor contact.		N/A
-(15.4.4)	Other circuits		N/A
	requirements in Table 6 of 15.4.5.		N/A
-(15.4.5)	Insulation between circuits and accessible conductive parts		N/A
	Accessible conductive parts shall be insulated from active parts of electric circuit by an insulation according to Table 6		N/A
	Class II construction with equipotential bonding for protection against indirect contacts with live parts:		N/A
	- conductive parts are connected together		N/A
	- the test of IEC 60598-1:2014, 7.2.3 (earth continuity test with 10 A) has to be carried out.		N/A
	- conductive parts comply with the requirements of Annex A of this standard in case of insulation fault between live parts and accessible conductive parts.		N/A

17 (16)	CREEPAGE DISTANCES AND CLEARANCES	P
---------	------------------------------------------	----------



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.

Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China

Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com

Scan code to check authenticity

**Attachment No.5**

IEC 61347-2-13			
Clause	Requirement + Test	Result - Remark	Verdict
- (16.1)	General		P
	Creepage distances and clearances according to 16.2 and 16.3		P
	Controlgears providing SELV comply with additional requirements in Annex L	(see Annex L)	P
	Insulating lining of metallic enclosures		N/A
	Controlgear protected against pollution comply with Annex P	(see Annex P)	N/A
- (16.2)	Creepage distances		P
- (16.2.2)	Minimum creepage distances for working voltages		P
	Creepage distances according to Table 7	(see appended table)	P
- (16.2.3)	Creepage distances for working voltages with frequencies above 30 kHz		N/A
	Creepage distances according to Table 8	(see appended table)	N/A
- (16.3)	Clearances		P
- (16.3.2)	Clearances for working voltages		P
	Clearances distances according to Table 9	(see appended table)	P
- (16.3.3)	Clearances for ignition voltages and working voltages with higher frequencies		N/A
	Clearances distances for basic or supplementary insulation according to Table 10	(see appended table)	N/A
	Clearances distances for reinforced insulation according to Table 11	(see appended table)	N/A

18 (17)	SCREWS, CURRENT-CARRYING PARTS AND CONNECTIONS		P
	Screws, current-carrying parts and connections in compliance with IEC 60598-1 (clause numbers between parentheses refer to IEC 60598-1)		P
(4.11)	Electrical connections		P
(4.11.1)	Contact pressure		P
(4.11.2)	Screws:		N/A
	- self-tapping screws		N/A
	- thread-cutting screws		N/A
(4.11.3)	Screw locking:		N/A
	- spring washer		N/A
	- rivets		N/A
(4.11.4)	Material of current-carrying parts		P



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.

Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China

Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com

Scan code to check authenticity

**Attachment No.5**

IEC 61347-2-13			
Clause	Requirement + Test	Result - Remark	Verdict

(4.11.5)	No contact to wood or mounting surface		P
(4.11.6)	Electro-mechanical contact systems		N/A
(4.12)	Mechanical connections and glands		N/A
(4.12.1)	Screws not made of soft metal		N/A
	Screws of insulating material		N/A
	Torque test: torque (Nm); part.....:		N/A
	Torque test: torque (Nm); part.....:	--	N/A
	Torque test: torque (Nm); part.....:	--	N/A
(4.12.2)	Screws with diameter < 3 mm screwed into metal		N/A
(4.12.4)	Locked connections:		N/A
	- fixed arms; torque (Nm).....:	--	N/A
	- lampholder; torque (Nm).....:	--	N/A
	- push-button switches; torque 0,8 Nm.....:	--	N/A
(4.12.5)	Screwed glands; force (Nm).....:	--	N/A

19 (18)	RESISTANCE TO HEAT, FIRE AND TRACKING		P
- (18.1)	Ball-pressure test	See IEC60598-2-22 part	P
- (18.2)	Test of printed boards	See IEC60598-2-22 part	P
- (18.3)	Glow-wire test	See IEC60598-2-22 part	P
- (18.4)	Needle flame test	See IEC60598-2-22 part	P
- (18.5)	Tracking test	See Test Table 19 (18.5)	N/A

20 (19)	RESISTANCE TO CORROSION		N/A
	- test according 4.18.1 of IEC 60598-1		N/A
	- adequate varnish on the outer surface		N/A

21 (-)	MAXIMUM WORKING VOLTAGE (U_{out}) IN ANY LOAD CONDITION		P
	Not exceed declared maximum working voltage U_{out} in any load condition		P

14	TABLE: tests of fault conditions		P
Part	Simulated fault		Hazard
See the report IEC 61347-2-7			





Attachment No.5

IEC 61347-2-13			
Clause	Requirement + Test	Result - Remark	Verdict



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.
Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China
Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com
Scan code to check authenticity



Attachment No.5

IEC/EN 61347-2-13			
Clause	Requirement + Test	Result - Remark	Verdict

A (A)	ANNEX A - TEST TO ESTABLISH WHETHER A CONDUCTIVE PART IS A LIVE PART WHICH MAY CAUSE AN ELECTRIC SHOCK		P
-(A.1)	Comply with A.2 or A.3	Rely up luminaries enclosure	N/A
-(A.2)	Voltage ≤ 35 V peak or ≤ 60 V d.c	--	N/A
-(A.3)	If voltage > 35 V peak or > 60 V d.c. or protective impedance device; touch current does not exceed 0,7 mA (peak) or 2 mA d.c.	--	N/A
	Comply with Annex G of IEC 60598-1		N/A

B (B)	Annex B - PARTICULAR REQUIREMENTS FOR THERMALLY PROTECTED LAMP CONTROLGEAR		N/A
B.7	Marking		N/A
	- the symbol for "class P" thermally protected lamp controlgear		N/A
	- the symbol for temperature declared thermally protected lamp controlgear		N/A
B.8	Thermal endurance of windings		N/A
B.9	Lamp controlgear heating		N/A
B.9.1	Preselection test		N/A
B.9.2	"Class P" thermally protected lamp controlgear		N/A
B.9.3	Temperature declared thermally protected lamp controlgear as specified in IEC 61347-2-8, with a rated maximum case temperature of 130°C or lower		N/A



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.

Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China

Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com

Scan code to check authenticity



Attachment No.5

IEC/EN 61347-2-13			
Clause	Requirement + Test	Result - Remark	Verdict

B.9.4	Temperature declared thermally protected lamp controlgear as specified in IEC61347-2-8 with a rated maximum case temperature exceeding 130°C		N/A
B.9.5	Temperature declared thermally protected lamp controlgear as specified in IEC61347-2-9		N/A

C (C)	ANNEX C – PARTICULAR REQUIREMENTS FOR ELECTRONIC LAMP CONTROLGEAR WITH MEANS OF PROTECTION AGAINST OVERHEATING		N/A
(C3)	GENERAL REQUIREMENTS		N/A
(C3.1)	Thermal protection means integral with the convertor, protected against mechanical damage		N/A
	Renewable only by means of a tool		N/A
	If function depending on polarity, for cord-connected equipment protection means in both leads		N/A
	Thermal links comply with IEC 60691		N/A
	Electrical controls comply with IEC 60730-2-3		N/A
(C3.2)	No risk of fire by breaking (clause C7)		N/A
(C5)	CLASSIFICATION		N/A
	a) automatic resetting type		—
	b) manual resetting type		—
	c) non-renewable, non-resetting type		—
	d) renewable, non-resetting type		—
	e) other type of thermal protection; description ... :	Electronic circuit	N/A
(C6)	MARKING		N/A
(C6.1)	Symbol for temperature declared thermally protected ballasts		N/A





Attachment No.5

IEC/EN 61347-2-13			
Clause	Requirement + Test	Result - Remark	Verdict
(C6.2)	Declaration of the type of protection provided		N/A
(C7)	LIMITATION OF HEATING		N/A
(C7.1)	Preselection test:		N/A
	Test sample placed for at least 12 h in an oven having temperature ($t_c - 5$) K		N/A
	No operation of the protection device		N/A
(C7.2)	Functioning of protection means:		N/A
	Normal operation of the sample in a test enclosure according to Annex D at an ambient temperature such that ($t_c + 0; -5$) °C is obtained		N/A
	No operation of the protection device		N/A
	Introducing of the most onerous test condition determined during test of clause 14		N/A
	Output of windings connected to the mains supply short-circuited, and other part of the convertor operated under normal conditions		N/A
	Increasing of the current through the windings continuously until operation of the protection means		N/A
	Continuous measuring of the highest surface temperature		N/A
	Ballasts according to C5 a) or C5 e) operated until stable conditions are achieved		N/A
	Automatic-resetting thermal protectors working 3 times		N/A
	Ballasts according to C5 b) working 6 times		N/A
	Ballasts according to C5 c) and C5) d) working once		N/A





Attachment No.5

IEC/EN 61347-2-13

Clause	Requirement + Test	Result - Remark	Verdict
	Highest temperature does not exceed the marked value		N/A
	Any overshoot of 10% over the marked value within 15 min		N/A
D (D)	ANNEX D – REQUIREMENTS FOR CARRY OUT THE HEATING TESTS OF THERMALLY PROTECTED LAMP CONTROLGEAR		N/A
	Tests in C7 performed in accordance with Annex D, if applicable		N/A
E (E)	ANNEX E – USE OF CONSTANT S OTHER THAN 4500 IN t_w TESTS		N/A
	Comply with tests according Annex E		N/A
F (F)	ANNEX F - DRAUGHT-PROOF ENCLOSURE		P
	Draught-proof enclosure in accordance with the description		P
	Dimensions of the enclosure		P
	Other design; description		P
H (H)	ANNEX H - TESTS		P
	All tests performed in accordance with the advice given in Annex H, if applicable		P
I (L)	ANNEX I: PARTICULAR ADDITIONAL REQUIREMENTS FOR SELV D.C. OR A.C. SUPPLIED ELECTRONIC CONTROLGEAR FOR LED MODULES		P
(L.3)	Classification		N/A
	Class I	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	—
	Class II	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	—



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.

Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China

Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com

Scan code to check authenticity



Attachment No.5

IEC/EN 61347-2-13			
Clause	Requirement + Test	Result - Remark	Verdict
	Class III	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	—
	non-inherently short circuit proof controlgear	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>	—
	inherently short circuit proof controlgear	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	—
	fail safe controlgear	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	—
	non-short-circuit proof controlgear	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	—
(L.4)	Marking		N/A
	Adequate symbols are used		N/A
(L.5)	Protection against electric shock		P
	Comply with 9.2 of IEC 61558-1		P
(L.6)	Heating		P
	No excessive temperatures in normal use		P
	Value if capacitor t_c marked	See ANNEX 1	—
	Winding insulation classified as Class	See ANNEX 1	—
	Comply with tests of clause 14 of IEC 61558-1 with adjustments		N/A
(L.7)	Short-circuit and overload protection		P
	Comply with tests of clause 15 of IEC 61558-1 with adjustments		P
(L.8)	Insulation resistance and electric strength		P
(L.8.1)	Conditioned 48 h between 91 % and 95 %		P
(L.8.2)	Insulation resistance		P
	Between input- and output circuits not less than 5 M Ω	>100 M Ω	P
	Between metal parts of class II convertors which are separated from live parts by basic insulation only and the body not less than 5 M Ω	--	N/A





Attachment No.5

IEC/EN 61347-2-13			
Clause	Requirement + Test	Result - Remark	Verdict
	Between metal foil in contact with the inner and outer surfaces of enclosures of insulating material not less than 2 MΩ	--	N/A
(L.8.3)	Electric strength		P
	1) Between live parts of input circuits and live parts of output circuits	3750V	P
	2) Over basic or supplementary insulation between:		P
	a) live parts having different polarity	1875V	P
	b) live parts and body if intended to be connected to protective earth	--	N/A
	c) accessible metal parts and a metal rod of the same diameter as the flexible cable or cord	--	N/A
	d) live parts and an intermediate metal part	--	N/A
	e) intermediate metal parts and the body	--	N/A
	f) each input circuit and all other input circuits	--	N/A
	3) Over reinforced insulation between the body and live parts	--	N/A
(L.9)	Construction		P
(L.9.1)	Transformer comply with 19.12 of IEC 61558-1 and 19 of IEC 61558-2-6		P
	HF transformer comply with 19 of IEC 61558-2-16		P
(L.10)	Components		P
	Protective devices comply with 20.6 – 20.11 of IEC 61558-1		N/A
(L.11)	Creepage distances, clearances and distances through insulation		N/A
	Creepage distances and clearances not less than in Clause 16		N/A
	Distance through insulation according Table L.5 in IEC 61347-1		N/A
	1) Basic distance through insulation		N/A
	Required distance (mm)	--	—



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.

Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China

Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com


Scan code to check authenticity



Attachment No.5

IEC/EN 61347-2-13

Clause	Requirement + Test	Result - Remark	Verdict
	Measured (mm) : --		N/A
	Supplementary information		—
	2) Supplementary distance through insulation		N/A
	Required distance (mm) : --		—
	Measured (mm) : --		N/A
	Supplementary information		—
	3) Reinforced distance through insulation		N/A
	Required distance (mm) : --		—
	Measured (mm) : --		N/A

Annex J (--)	Particular additional safety requirements for a.c., a.c./d.c. or d.c. supplied electronic controlgear for emergency lighting		N/A
J.1 (--)	General		N/A
J.2 (--)	Marking		N/A
J.2.1	Mandatory markings		N/A
	a) symbol of a.c., a.c./d.c. or d.c maintained emergency electronic controlgear		N/A
	b) rated emergency power supply voltage or voltage range		N/A
J.2.2	Information to be provided if applicable		N/A
	a) Limits of the ambient temperature range		N/A
	b) Emergency output factor		N/A
	c) Information on whether the control gear is intended for use in luminaires for high-risk task area lighting		N/A
J.3	General notes on tests		N/A
J.4	Starting conditions		N/A
	Control gears shall start rated load(s) without adversely affecting the performance when operated in emergency mode		N/A



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.

Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China

Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com

Scan code to check authenticity



Attachment No.5

IEC/EN 61347-2-13			
Clause	Requirement + Test	Result - Remark	Verdict
J.5	Operating condition		N/A
	The provisions of 7.2 of IEC 62384:2006 apply at 90 % and 110 % of the rated emergency supply voltage		N/A
J.6	Emergency supply current		N/A
	At the rated emergency supply voltage or voltage range, the emergency supply current shall not differ by more than ± 15 % from the declared value when the control gear is operated in emergency mode with maximum load power		N/A
J.7	EMC immunity		N/A
J.8	Pulse voltage from central battery systems		N/A
	The d.c. supplied emergency controlgear shall withstand, without failure, any pulses caused by switching other equipment in the same circuit		N/A
J.9	Tests for abnormal conditions		N/A
	The provisions of Clause 12 of IEC 62384:2006 apply		N/A
J.10	Temperature cycling test and endurance test		N/A
	The provisions of Clause 13 of IEC 62384:2006 apply		N/A
J.11	Functional safety		N/A
	EOFx is measured 5 s and 60 s after switch on of the control gear in emergency mode at maximum emergency supply voltage and at minimum emergency supply voltage		N/A
	For the calculation of EOFx the lower value of the measurements below is used:		N/A
	a) electrical output parameter measured after 60 s at maximum voltage/electrical output parameter measured in reference setting		N/A



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.

Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China

Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com

Scan code to check authenticity



Attachment No.5

IEC/EN 61347-2-13			
Clause	Requirement + Test	Result - Remark	Verdict

	b) electrical output parameter measured in steady state conditions at minimum supply voltage/electrical output parameter measured in reference setting		N/A
	After 5 s of operation with maximum emergency supply voltage at least 50 % of the declared EOFx shall be reached		N/A

(N)	ANNEX N: REQUIREMENTS FOR INSULATION MATERIALS USED FOR DOUBLE OR REINFORCED INSULATION		N/A
(N.4)	General requirements		N/A
(N.4.1)	Material comply with IEC 60085 and IEC 60216 series		N/A
(N.4.2)	Solid insulation		N/A
	Electric strength test at least 5 kV or 1,35 x test voltage in Table N.1		N/A
	If not classified according IEC 60085 and IEC 60216 series: Electric strength test increased 10 % of 5,5 kV or 1,5 x test voltage in Table N.1		N/A
(N.4.3)	Thin sheet insulation		N/A
(N.4.3.1)	Thickness and composition of thin sheet insulation		N/A
	- Inside the ballast and not subjected to handling or abrasion during the production and during maintenance		N/A
	- Non-separated layers: Min. 3 layers and fulfil mandrel test of 150N		N/A
	- Separated layers: Min. 2 layers and each layer fulfil mandrel test of 50N		N/A
	- Separated layers (alternative): Min. 3 layers and 2/3 of the layers fulfil mandrel test of 100N		N/A
(N.4.3.2)	Mandrel test (electric strength test during mechanical stress)		N/A





Attachment No.5

IEC/EN 61347-2-13

Clause	Requirement + Test	Result - Remark	Verdict
--------	--------------------	-----------------	---------

	Electric strength test after mandrel test:		N/A
	- Non-separated layers: min. 5 kV or 1,35 x test voltage in Table N.1		N/A
	- 2/3 of min. 3 separated layers: min. 5 kV or 1,25 x test voltage in Table N.1		N/A
	- one of 2 separated layers: min. 5 kV or 1,25 x test voltage in Table N.1		N/A
	No flashover or breakdown occurred		N/A

(O)	ANNEX O: ADDITIONAL REQUIREMENTS FOR BUILT-IN ELECTRONIC CONTROLGEAR WITH DOUBLE OR REINFORCED INSULATION		N/A
(O.6)	Marking		N/A
	Marking according clause 7 (7)	See clause 7	N/A
	Special symbol		N/A
	Meaning of the special symbol explained in catalogue		N/A
(O.7)	Protection against accidental contact with live parts		N/A
	Requirements of clause 8 (10)	See clause 8	N/A
	Test finger not possible to make contact with basic insulated metal parts		N/A
(O.8)	Terminals		N/A
	Clause 9 (8)	See clause 9	N/A
(O.9)	Provision for earthing		N/A
	Functional earthing terminals comply with clause 9 of part 1		N/A
	No protective earthing terminal		N/A
(O.10)	Moisture resistance and insulation		N/A
	Clause 11 (11)	See clause 11	N/A
(O.11)	Electric strength		N/A



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.

Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China

Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com

Scan code to check authenticity



Attachment No.5

IEC/EN 61347-2-13			
Clause	Requirement + Test	Result - Remark	Verdict
	Clause 12 (12)	See clause 12	N/A
(O.13)	Fault conditions		N/A
	Clause 14 (14)	See clause 14	N/A
	End of test, between live part and accessible metal parts or external parts of insulating material in contact with the supporting surface comply with dielectric strength test reduced to 35 % of values according Table 1 in part 1		N/A
	Insulation resistance according to O.10 between live part and accessible metal parts or external parts of insulating material in contact with the supporting surface not less than 4 MΩ		N/A
(O.14)	Construction		N/A
	Clause 17 (15)	See clause 17	N/A
	Accessible metal parts insulated from live parts by double or reinforced insulation		N/A
	Live part insulated from supporting surface in contact with external faces by double or reinforced insulation		N/A
(O.15)	Creepage distances and clearances		N/A
	Clause 18 (16)	See clause 18	N/A
	Comply with corresponding values for luminaries in IEC 60598-1		N/A
(O.16)	Screws, current-carrying parts and connections		N/A
	Clause 19 (17)	See clause 19	N/A
(O.17)	Resistance to heat and fire		N/A
	Clause 20 (18)	See clause 20	N/A
(O.18)	Resistance to corrosion		N/A
	Clause 21 (19)	See clause 21	N/A





Attachment No.5

IEC/EN 61347-2-13			
Clause	Requirement + Test		Verdict
(P)	Creepage distances and clearances and distance through isolation (DTI) for lamp controlgear which are protected against pollution by the use of coating or potting		N/A
(P.1)	General		N/A
	P.2 applies if creepage distances less than the minimum in Table 7 and 8		N/A
	P.3 applies if clearance less than the minimum in Table 9, 10 and 11		N/A
(P.2)	Creepage distances		N/A
(P.2.2)	Minimum creepage distances for working voltages and rated voltages with frequencies up to 30 kHz (Table P.1)		N/A
	Basic or supplementary insulation:		N/A
	Required creepage.....: --		—
	Measured.....: --		N/A
	Supplementary information		—
	Reinforced insulation:		N/A
	Required creepage.....: --		—
	Measured.....: --		N/A
	Supplementary information		—
(P.2.3)	Creepage distances for working voltages with frequencies above 30 kHz (Table P.2)		N/A
	Voltage \hat{U}_{out} kV: --		—
	Frequency.....: --		—
	Required distance.....: --		—
	Measured.....: --		N/A
	Supplementary information		—
(P.2.4)	Compliance with the required creepage distances		N/A
(P.2.4.1)	Compliance in accordance with 16.3.3 and test according P.2.4.2		N/A



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.

Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China

Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com

Scan code to check authenticity



Attachment No.5

IEC/EN 61347-2-13			
Clause	Requirement + Test		Verdict
(P.2.4.3)	Electrical tests after conditioning		N/A
(P.2.4.3.1)	Insulation resistance and electric strength according Clause 11 and 12		N/A
(P.3)	Distance through isolation		N/A
(P.3.4)	Electrical tests after conditioning		N/A
(P.3.4.1)	Insulation resistance and electric strength according Clause 11 and 12		N/A
(P.3.4.2)	Impulse voltage dielectrical test		N/A
	Basic or supplementary insulation:		N/A
	Working/rated voltage	--	—
	Impulse voltage.....	--	N/A
	Supplementary information		—
	Reinforced insulation:		N/A
	Working/rated voltage	--	—
	Impulse voltage.....	--	N/A
	Supplementary information		—





Attachment No.6

Photo Documentation

Model: DS-ES-01S



Photo 1



Photo 2



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.

Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China

Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com

Scan code to check authenticity



Attachment No.6

Photo Documentation

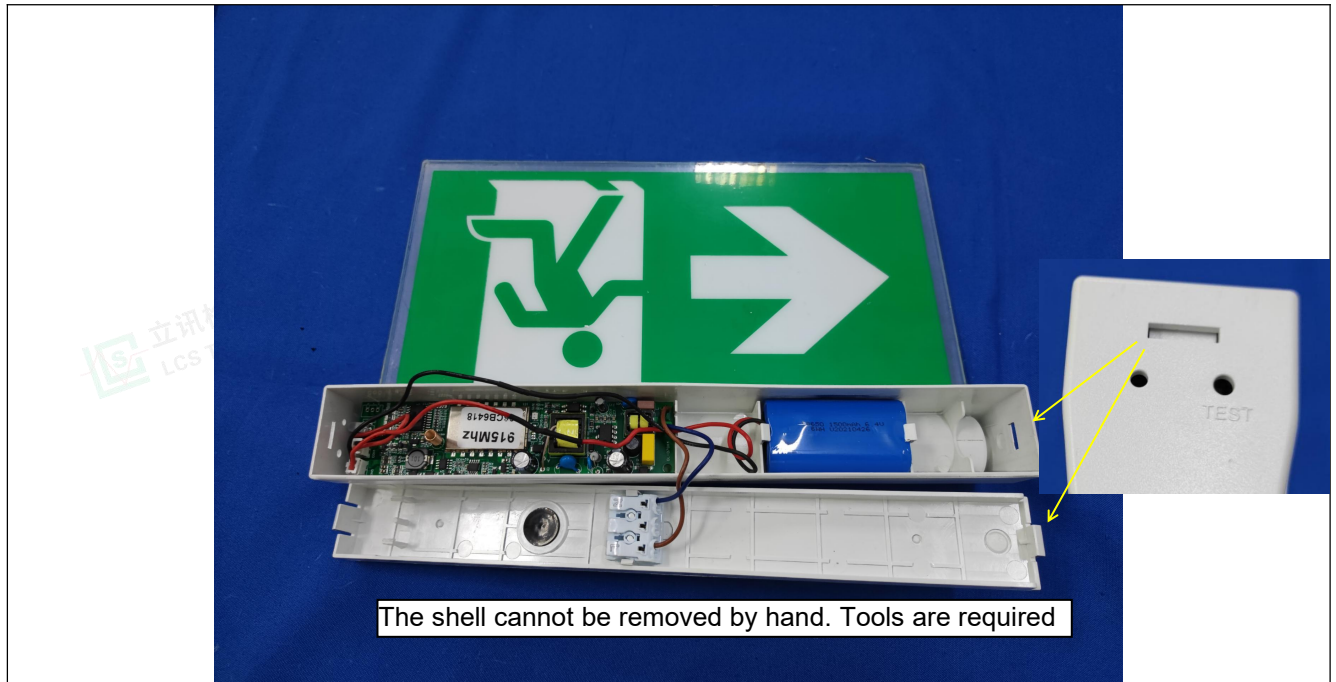


Photo 3



Photo 4





Attachment No.6

Photo Documentation

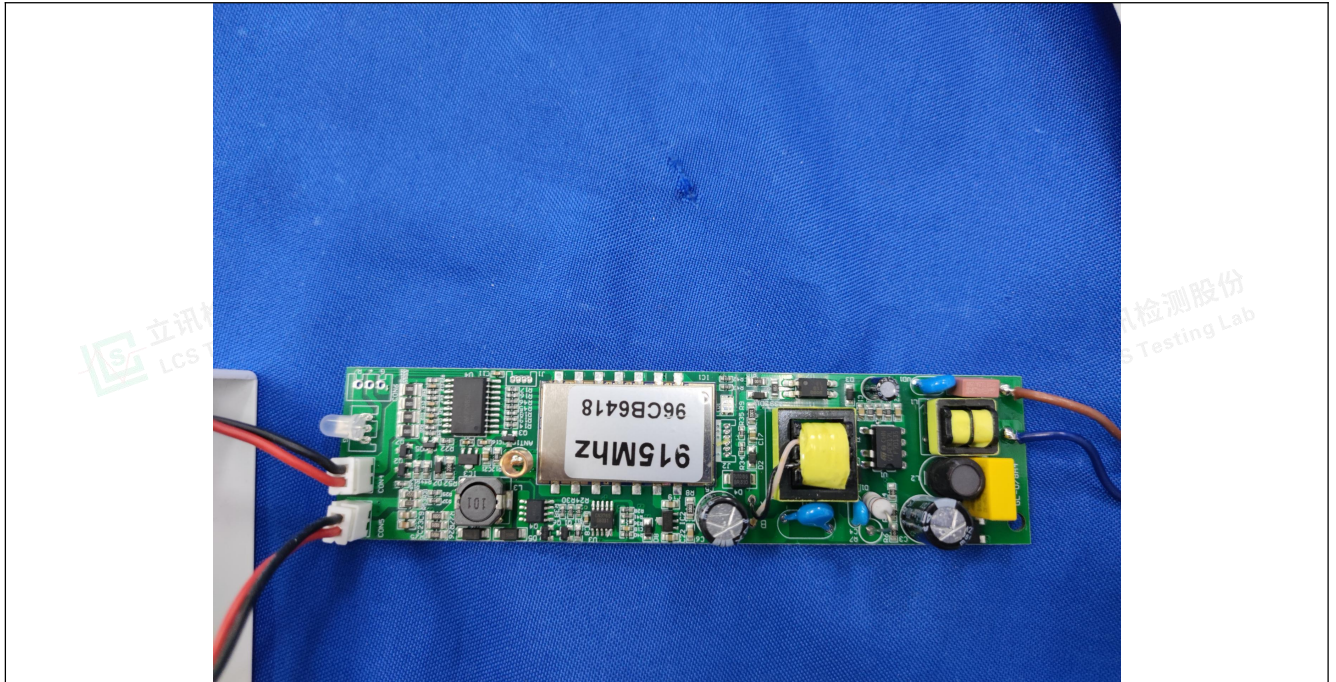


Photo 5

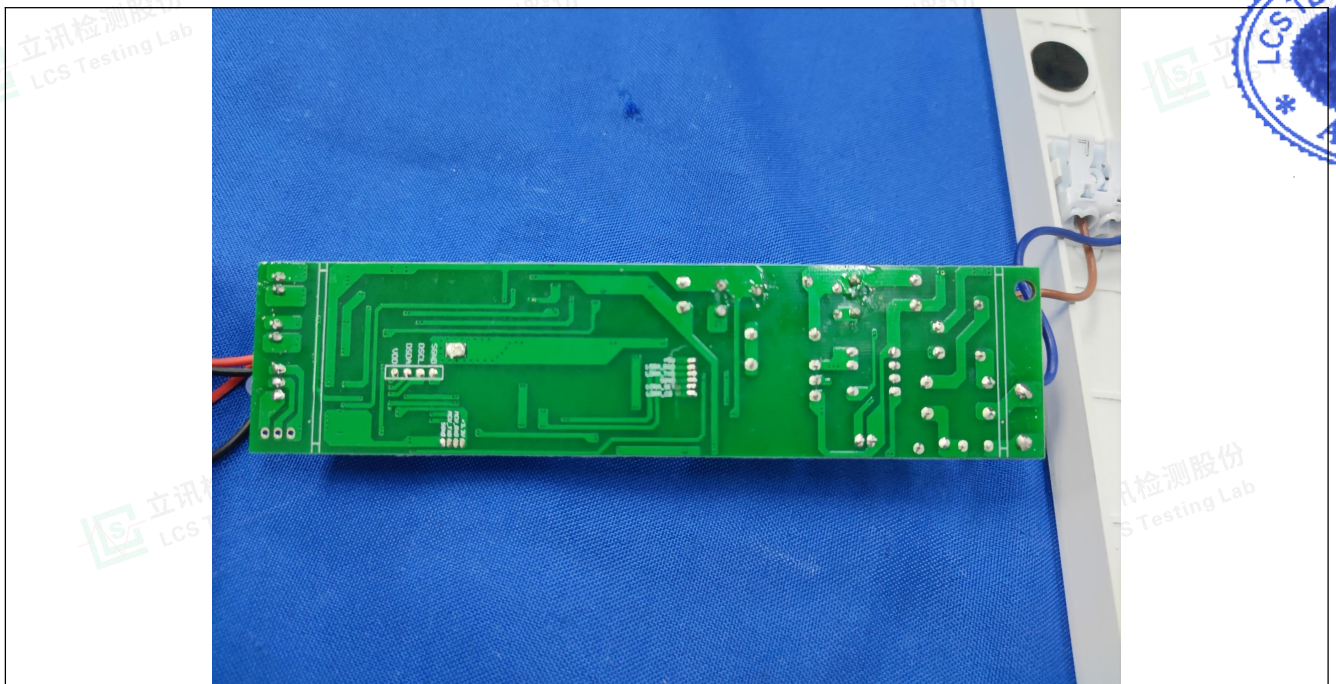


Photo 6



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.
Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China
Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com
Scan code to check authenticity



Attachment No.6

Photo Documentation



Photo 7

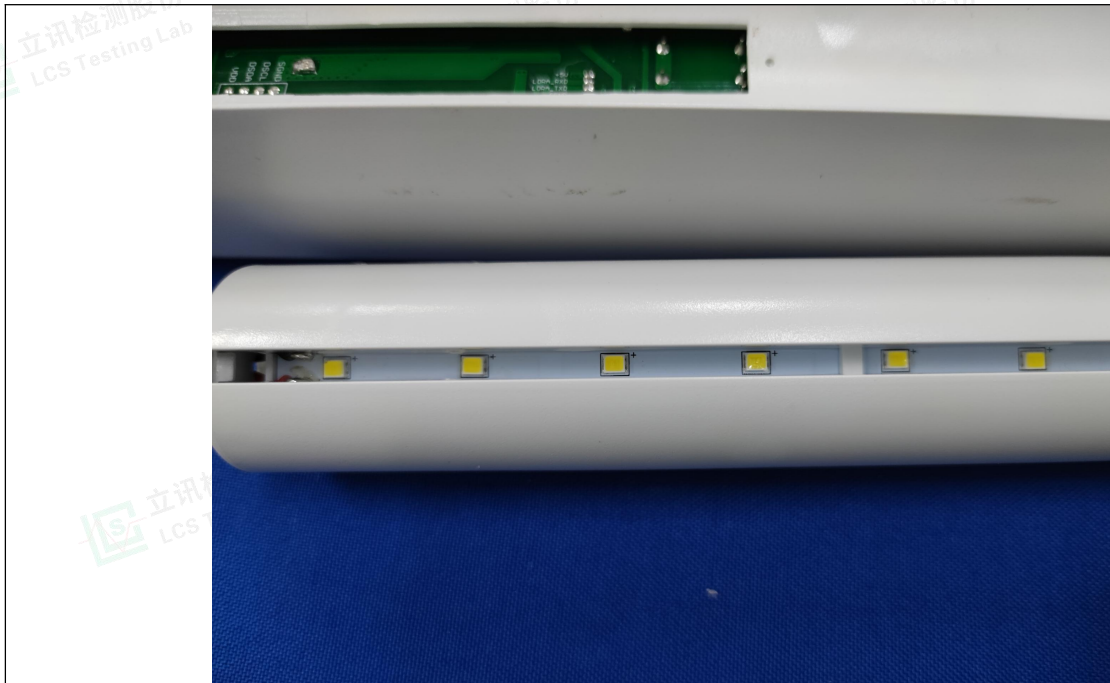


Photo 8



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.
Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China
Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com
Scan code to check authenticity



Attachment No.6

Photo Documentation

Model: DS-ES-02S



Photo 9

Model: DS-ES-03S



Photo 10



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.

Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China

Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com

Scan code to check authenticity



Attachment No.6

Photo Documentation

Model: DS-ES-04S



Photo 11

Model: DS-ES-05S



Photo 12



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.

Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China

Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com

Scan code to check authenticity



Attachment No.6

Photo Documentation

Model: DS-ES-06S



Photo 13

-----End of Test Report-----



Shenzhen Southern LCS Compliance Testing Laboratory Ltd.
Add: 101-201, No.39 Building, Xialang Industrial Zone, Heshuikou Community, Matian Street, Guangming District, Shenzhen, China
Tel: +(86) 0755-29871520 | E-mail: webmaster@lcs-cert.com | Web: www.lcs-cert.com
Scan code to check authenticity